

PO Box 1 • Ilkley • West Yorkshire • LS29 8EU
Phone: 01943 602001 • Fax: 01943 816796
Website: www.issltd.co.uk • Email: sales@issltd.co.uk



Instrumentation
Systems & Services Ltd











Electrical Safety

This equipment complies with the requirements of CEI/IEC 61010-1:2001-2 "Safety Requirements for Electrical Equipment for Measurement, Control and Laboratory Use". If the equipment is used in a manner NOT specified by the Company, the protection provided by the equipment may be impaired.

Symbols

One or more of the following symbols may appear on the instrument labelling:

	Warning – Refer to the manual for instructions		Direct current supply only
	Caution – Risk of electric shock		Alternating current supply only
	Protective earth (ground) terminal		Both direct and alternating current supply
	Earth (ground) terminal		The equipment is protected through double insulation

Information in this manual is intended only to assist our customers in the efficient operation of our equipment. Use of this manual for any other purpose is specifically prohibited and its contents are not to be reproduced in full or part without prior approval of the Technical Publications Department.

Health and Safety

To ensure that our products are safe and without risk to health, the following points must be noted:


1. The relevant sections of these instructions must be read carefully before proceeding.
2. Warning labels on containers and packages must be observed.
3. Installation, operation, maintenance and servicing must only be carried out by suitably trained personnel and in accordance with the information given.
4. Normal safety precautions must be taken to avoid the possibility of an accident occurring when operating in conditions of high pressure and/or temperature.
5. Chemicals must be stored away from heat, protected from temperature extremes and powders kept dry. Normal safe handling procedures must be used.
6. When disposing of chemicals ensure that no two chemicals are mixed.

Safety advice concerning the use of the equipment described in this manual or any relevant hazard data sheets (where applicable) may be obtained from the Company address on the back cover, together with servicing and spares information.




GETTING STARTED

This manual is divided into 5 sections which contain all the information needed to install, configure, commission and operate the COMMANDER V100. Each section is identified clearly by a symbol as shown below.



Displays and Function Keys

- Displays and function keys
- LED Indication
- Error Messages




Operator Mode (Level 1)

- Operator menus for:
 - *Standard controller*
 - *Remote Set Point controller*
 - *Profile controller*
 - *Multiple Fixed Set Points controller*



Set Up Mode (Levels 2, 3 and 4)

- Level 2 – Tuning
- Level 3 – Set Points
- Level 4 – Profile



Configuration Mode (Levels 5 and 6)

- Level 5 – Basic hardware and control functions
- Level 6 – Ranges and passwords



Installation

- Siting
- Mounting
- Electrical connections


Symbol Identification and Section Contents

CONTENTS

1	DISPLAYS AND FUNCTION KEYS	3
1.1	Introduction	3
1.2	Use of Function Keys	4
1.3	LED Alarms and Indicators	5
1.4	Error Messages	6
2	OPERATOR MODE	7
2.1	Introduction	7
2.2	Standard Controller	8
2.3	Remote Set Point Controller	10
2.4	Profile Controller	12
2.5	Multiple Fixed Set Points Controller	14
3	SET UP MODE	16
3.1	Introduction	16
3.2	Motorized Valve Control	17
3.3	Tuning (Level 2)	19
3.4	Set Points (Level 3)	20
3.5	Profile (Level 4)	23
4	CONFIGURATION MODE	26
4.1	Introduction	26
4.2	Accessing the Configuration Mode	26
4.3	Basic Hardware and Configuration (Level 5)	28
4.4	Ranges and Passwords (Level 6)	38
5	INSTALLATION	41
5.1	Siting	41
5.2	Mounting	43
5.3	Electrical Connections	45
5.4	Relays, Arc Suppression, Inputs and Outputs	45

Information.


The fold-out page inside on the back cover of this manual shows all the frames in the programming levels. Space is provided on the page for writing the programmed setting or selection for each frame.

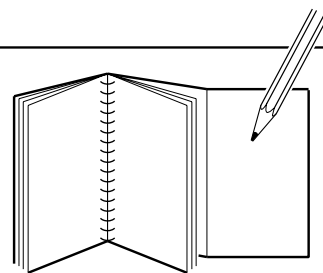

1 DISPLAYS AND FUNCTION KEYS

1.1 Introduction – Fig. 1.1

The COMMANDER V100 front panel displays, function keys and LED indicators are shown in Fig. 1.1.

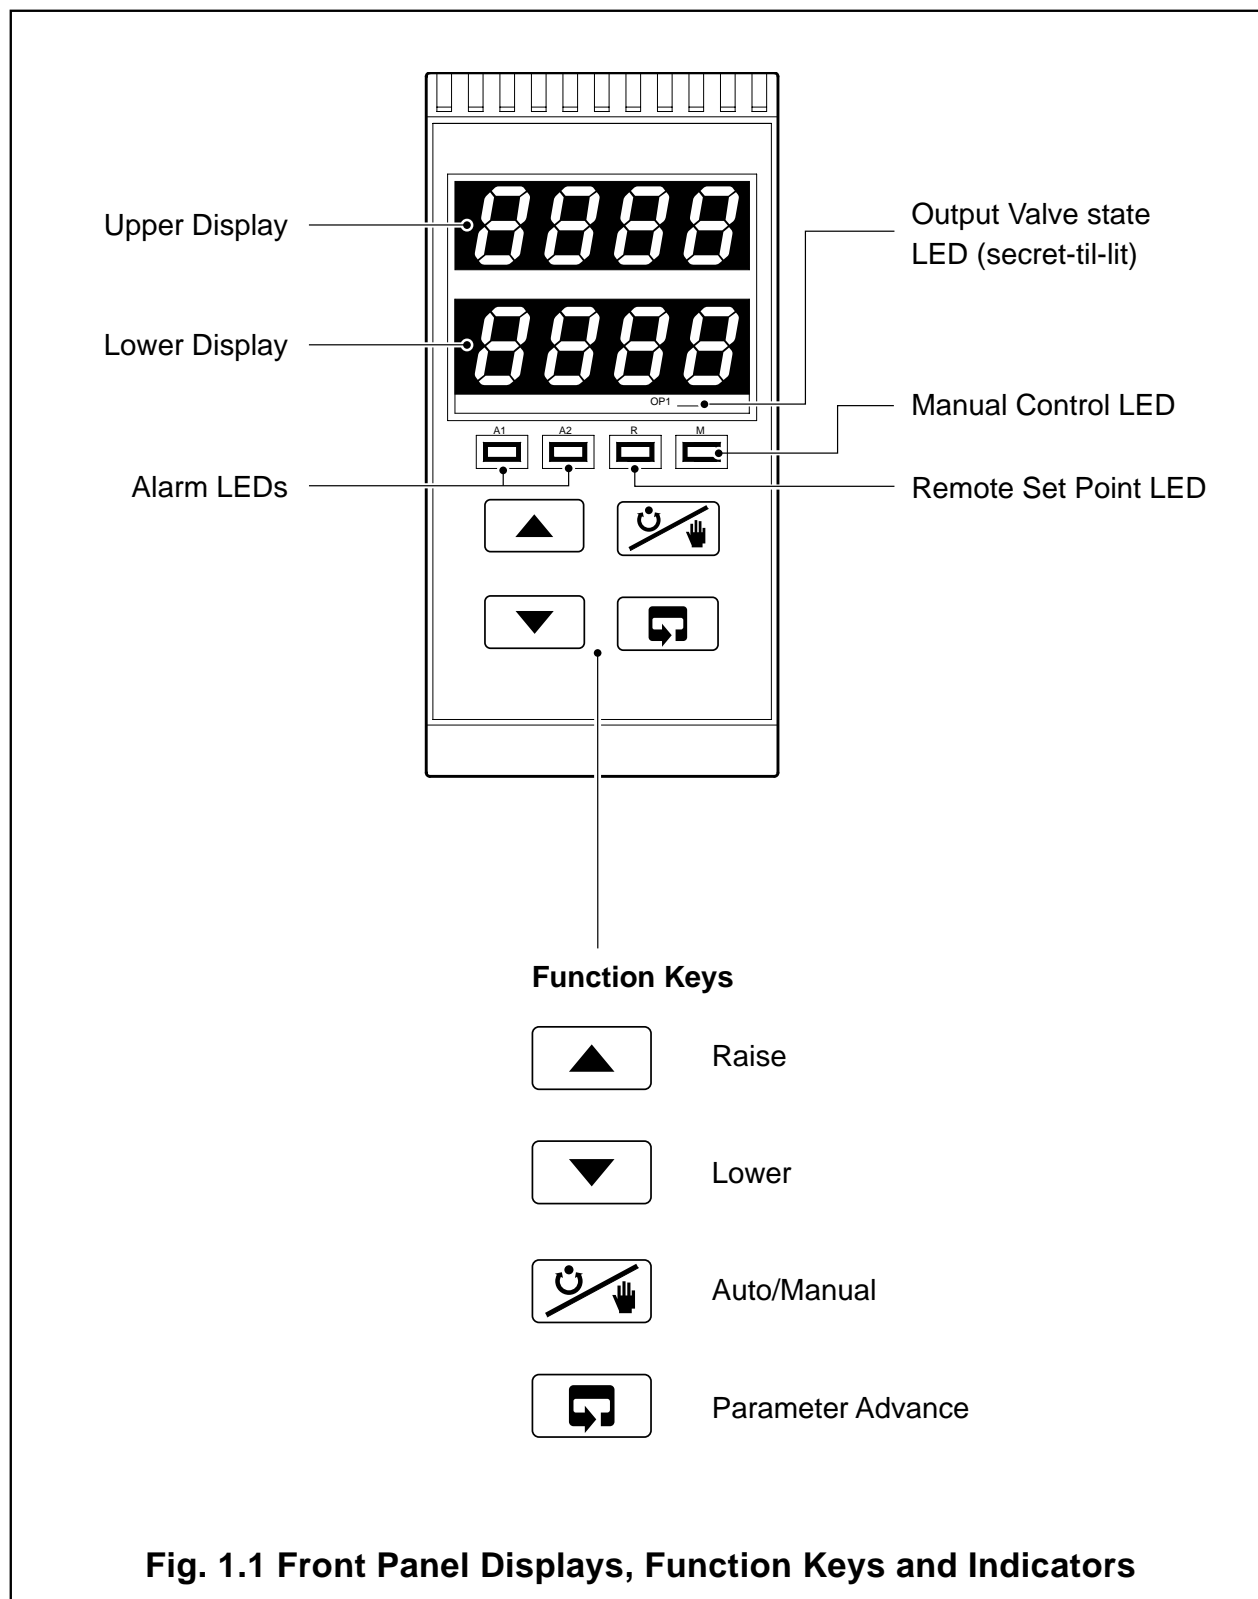

1.2 Use of Function Keys – Fig. 1.2


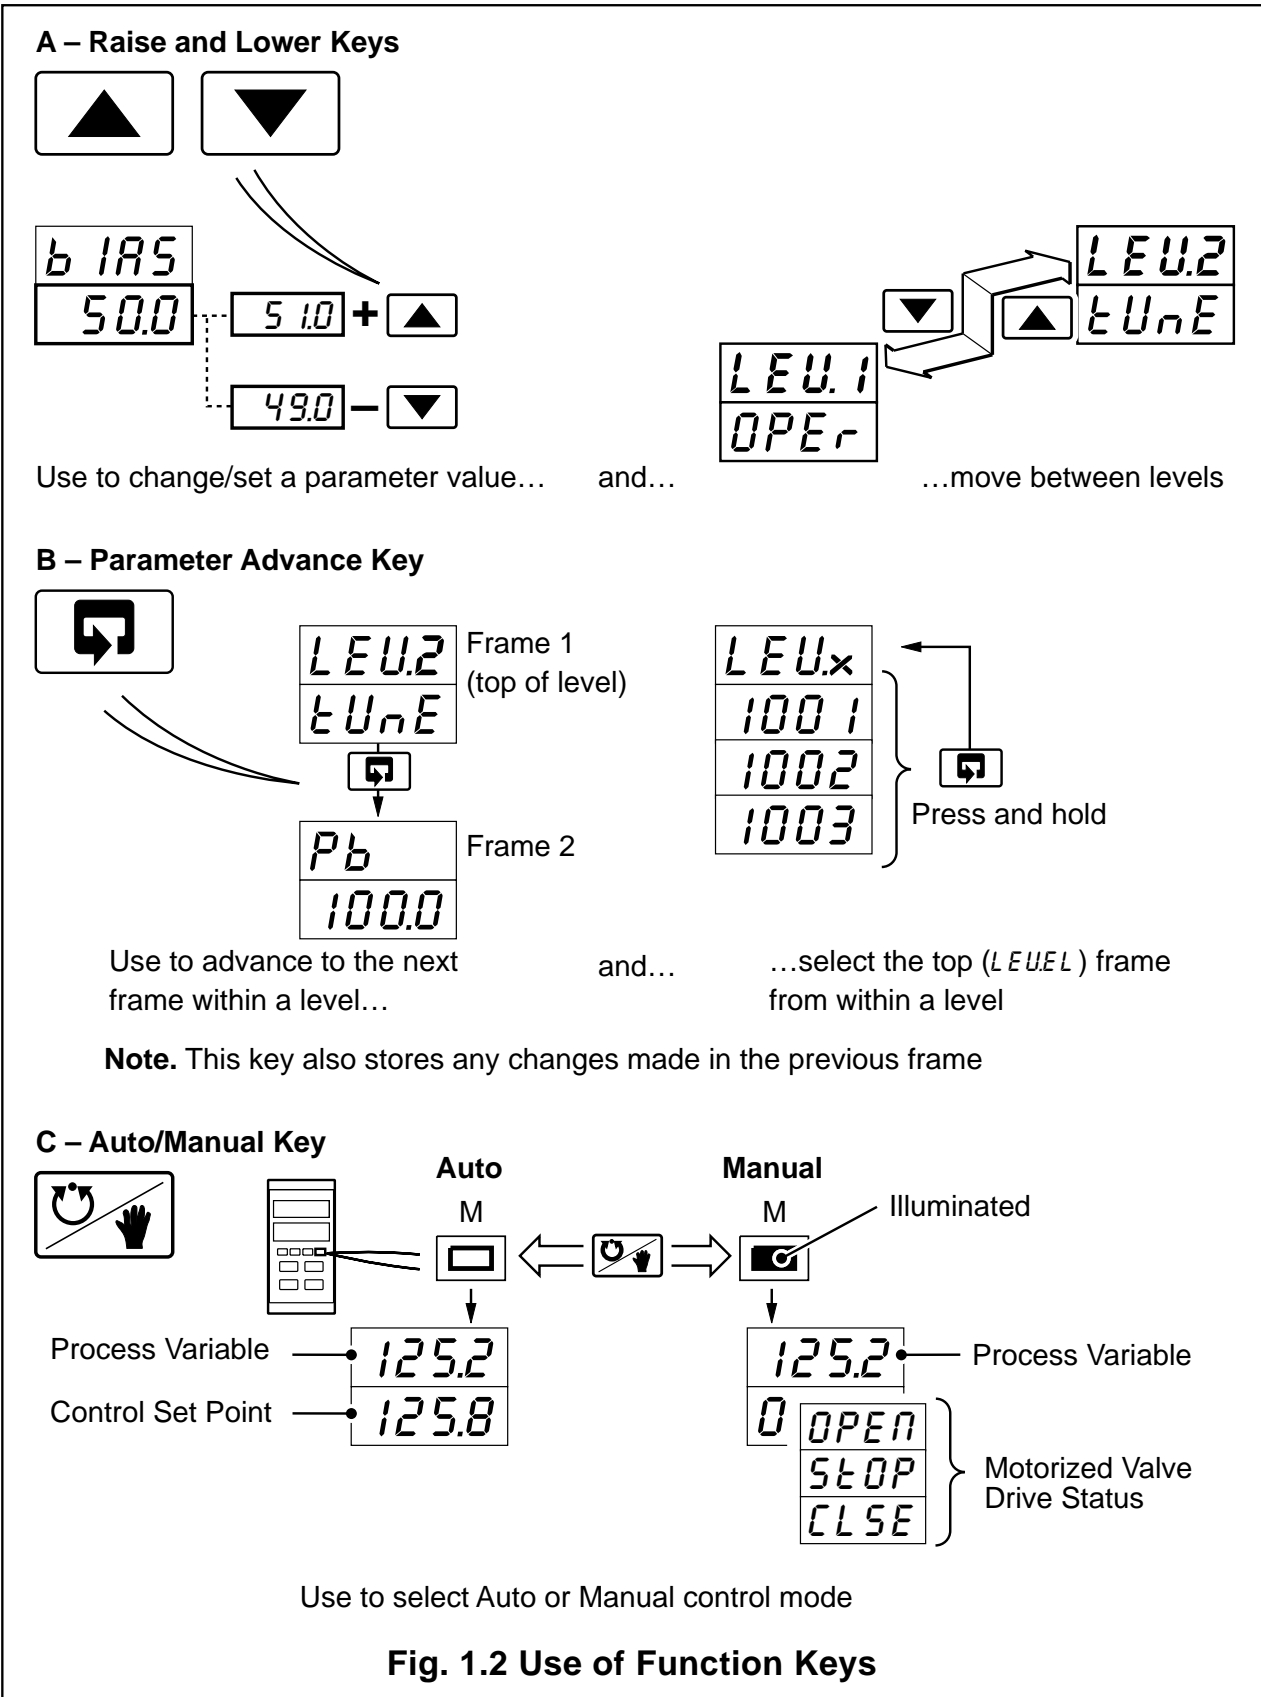


Fig. 1.2 Use of Function Keys

1.3 LED Alarms and Indicators

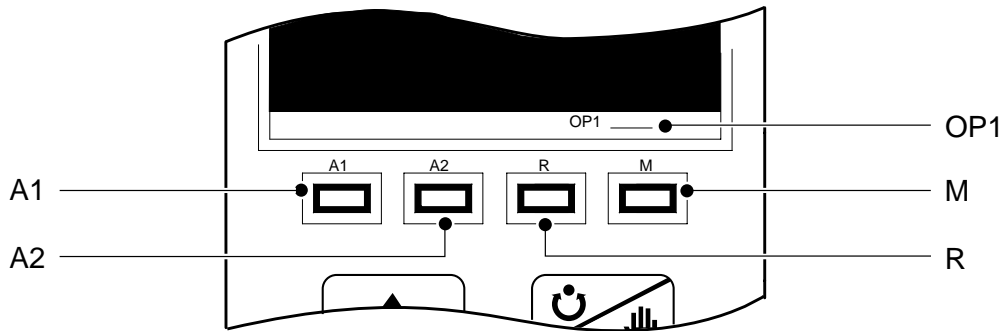









LED Status

- All** • All LED's flashing – controller is in the configuration mode.
- A1** • Flashes when Alarm 1 is active (off when inactive).
- A2** • Flashes when Alarm 2 is active (off when inactive).
- R**
 - On when the controller is operating on the remote set point value.
 - Off when the controller is operating using the local set point value or one of the four fixed set points (in multiple set point mode).
 - Flashes when a Ramp/Soak profile is running.
- M**
 - On when the controller is operating in Manual control mode.
 - Off when the controller is operating in Auto control mode.
- OPI** • Secret-til-lit LED indicates when the output valve state is displayed in the lower display.

Fig. 1.3 LED Alarms and Indicators

1.4 Error Messages

Display	Error/Action	To Clear Display
	<p>Calibration error Turn mains power off and on again (if the error persists contact the Service Organization).</p>	Press the  key
	<p>Configuration error The configuration and/or setup data for the instrument is corrupted. Turn mains power off and on again (if the error persists, check configuration/setup settings).</p>	Press the  key
	<p>A to D Converter Fault The analog to digital converter is not communicating correctly.</p>	Turn the power off and on again, if the error persists contact the service organization.
	<p>Process Variable Over/Under Range</p>	Restore valid input
	<p>Remote Set Point Over/Under Range The remote set point value is over or under range. Flashing stops automatically when the remote set point input comes back into range.</p>	Select the local set point (rSP.n) in the Operating Page or the Set Points Level
	<p>Option error Communications to the option board have failed.</p>	Contact the Service Organization

2 OPERATOR MODE



2.1 Introduction

Operator Mode (Level 1) is the normal day-to-day mode of the COMMANDER 100. Frames displayed in level 1 are determined by the control strategy which is selected during configuration of the instrument – see Section 4.

Note. Only the operating frames relevant to the configured strategy are displayed in Operator Mode.


The four control strategies are:

- **Standard controller** – page 8
- **Remote Set Point controller** – page 10
- **Profile controller** – page 12
- **Multiple Fixed Set Points controller** – page 14






2.2 Standard Controller

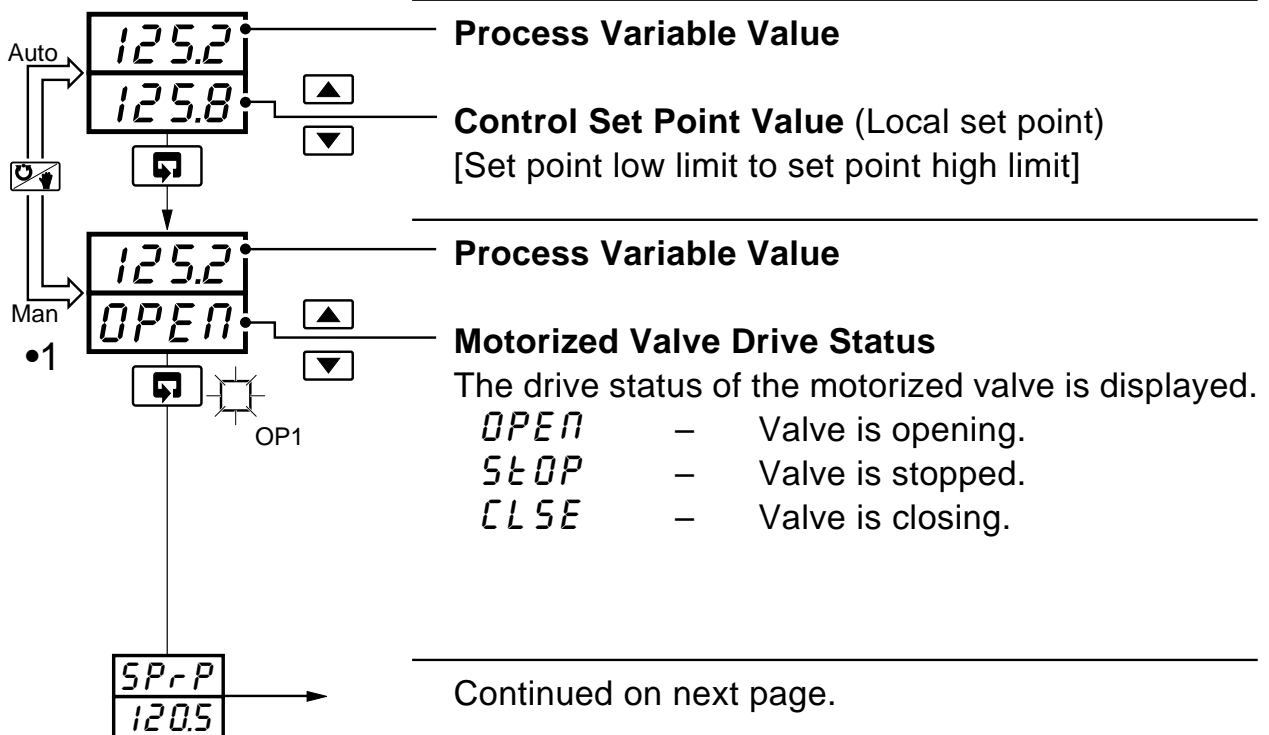

- 1 The Valve Drive Status is adjustable in Manual mode only.



...2.2 Standard Controller

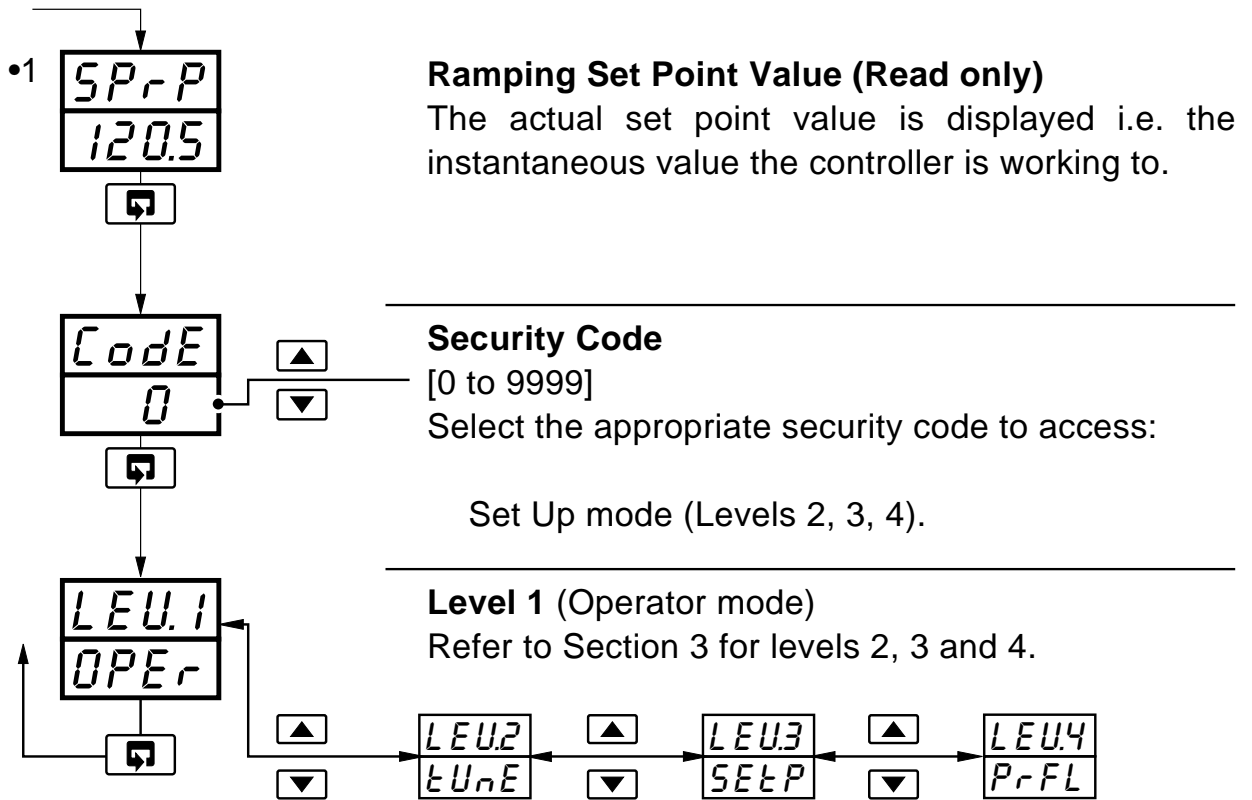


- 1 Not displayed if the ramping set point facility is turned off – refer to Section 3.4.



...2 OPERATOR MODE

2.3 Remote Set Point Controller

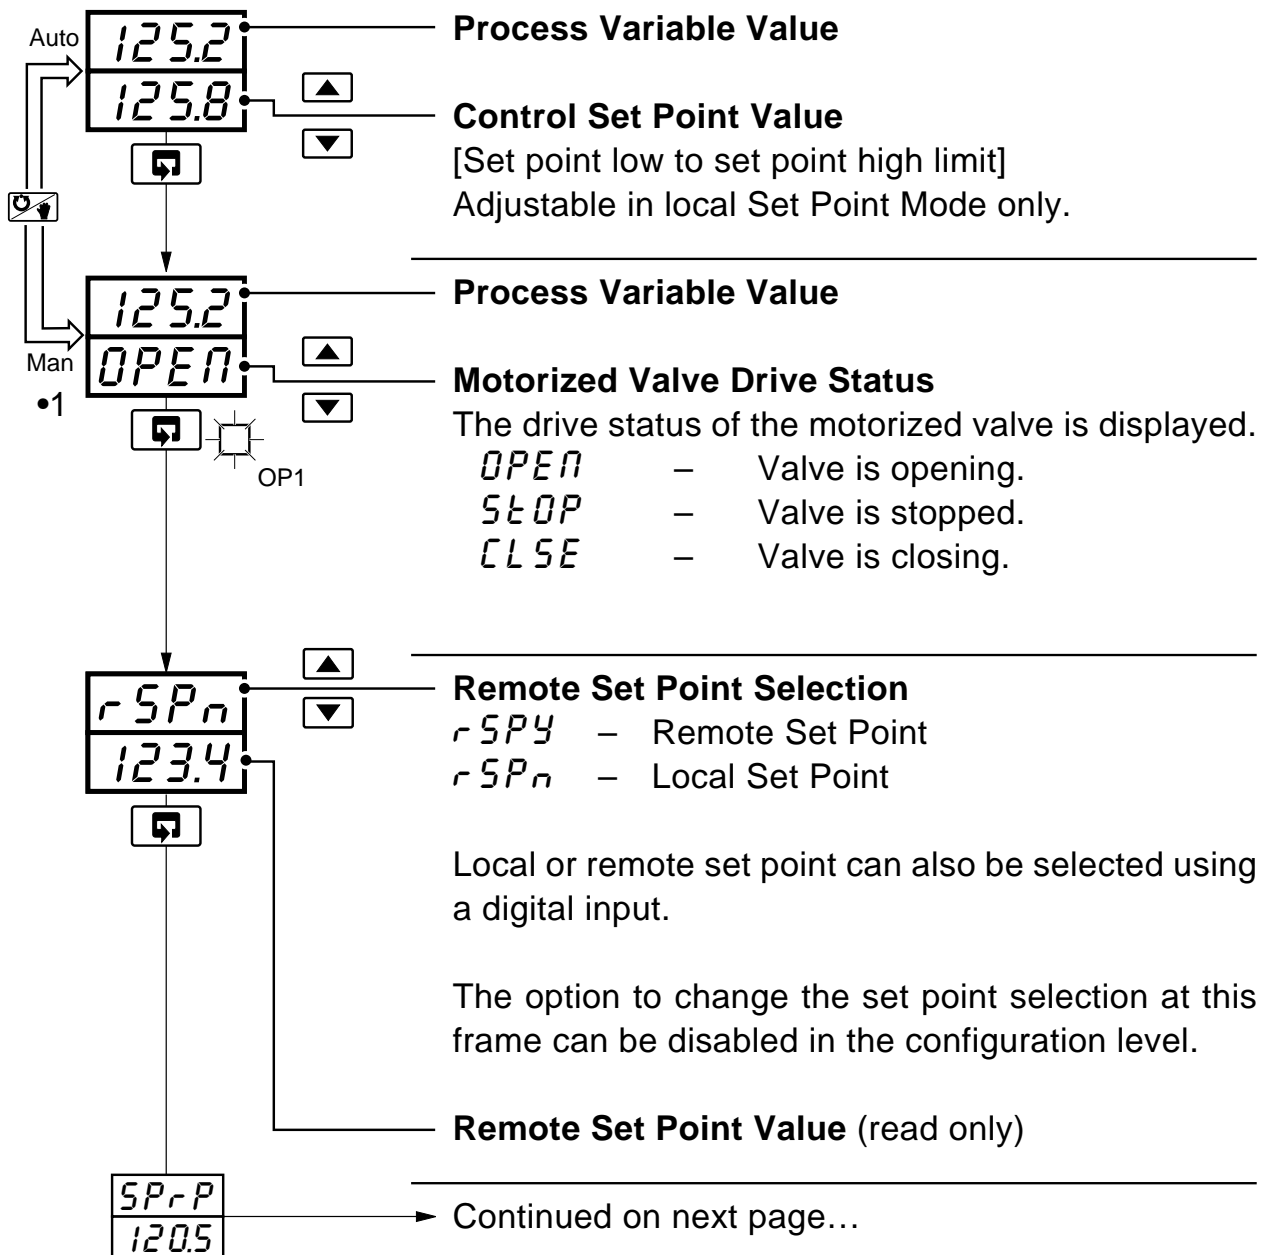


Note.

If the remote set point input fails while selected, the controller selects the local set point value automatically. The upper display changes to *rSP.F* and the lower display flashes. When the fault condition is removed the remote set point is re-selected automatically. To clear the error condition while the remote set point input is still outside its allowed range, select the local set point by pressing the key (*rSP.n* is displayed).

•1 The Valve Drive Status is adjustable in Manual mode only.



...2.3 Remote Set Point Controller

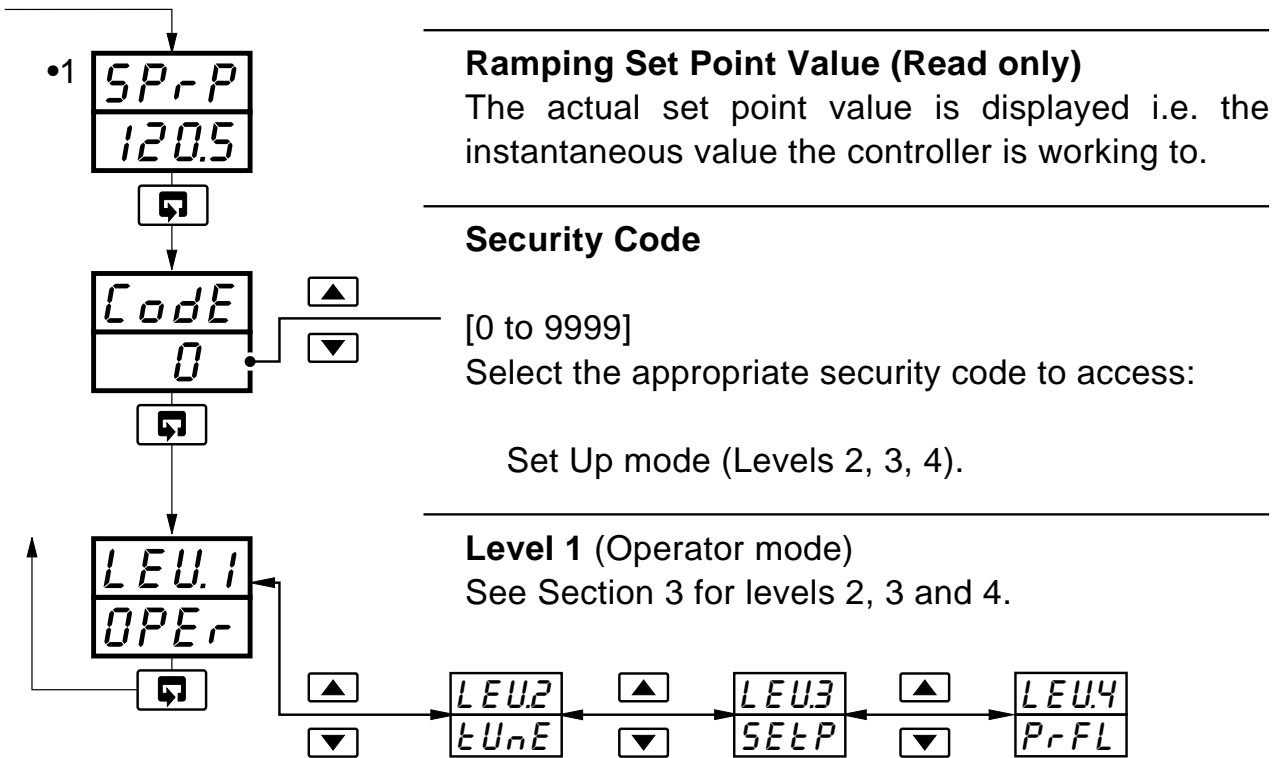


- 1 Not displayed if the ramping set point facility is turned off – refer to Section 3.4.





2.4 Profile Controller

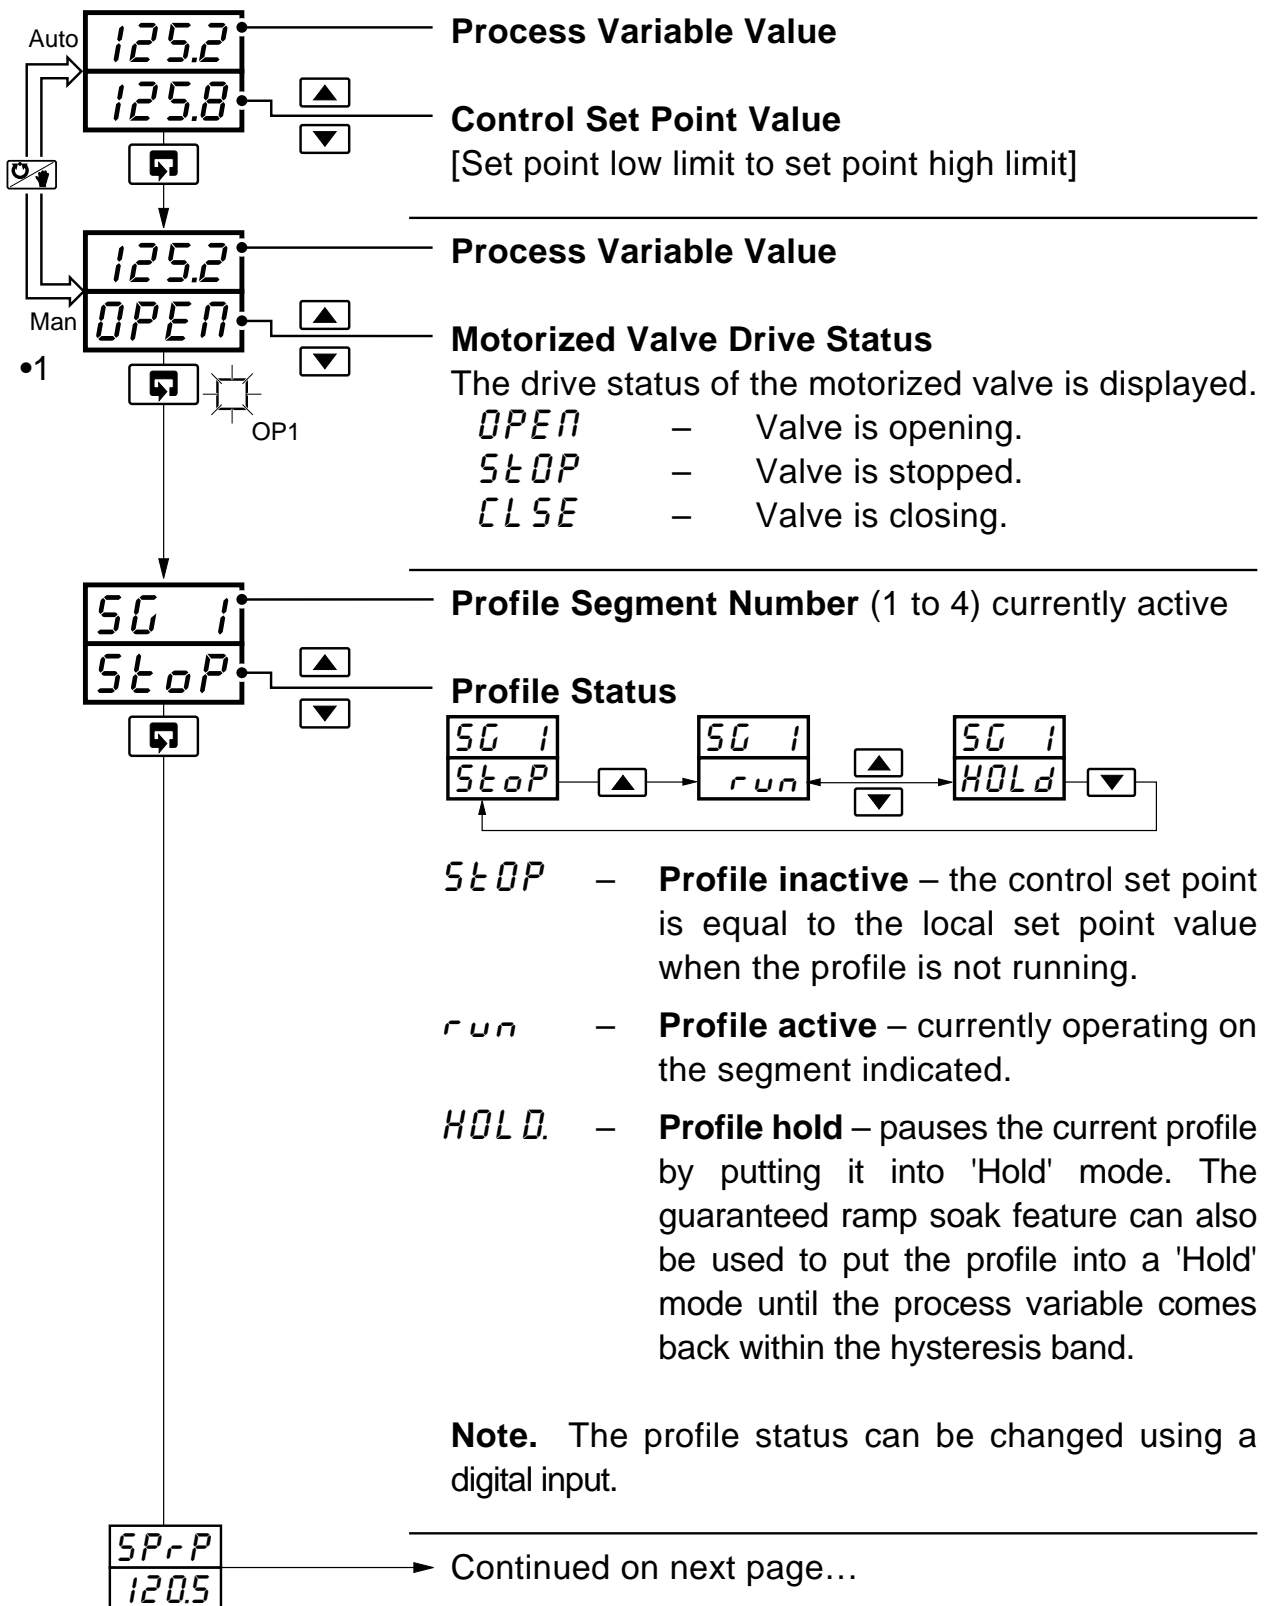


•1 The Valve Drive Status is adjustable in Manual mode only.





...2.4 Profile Controller

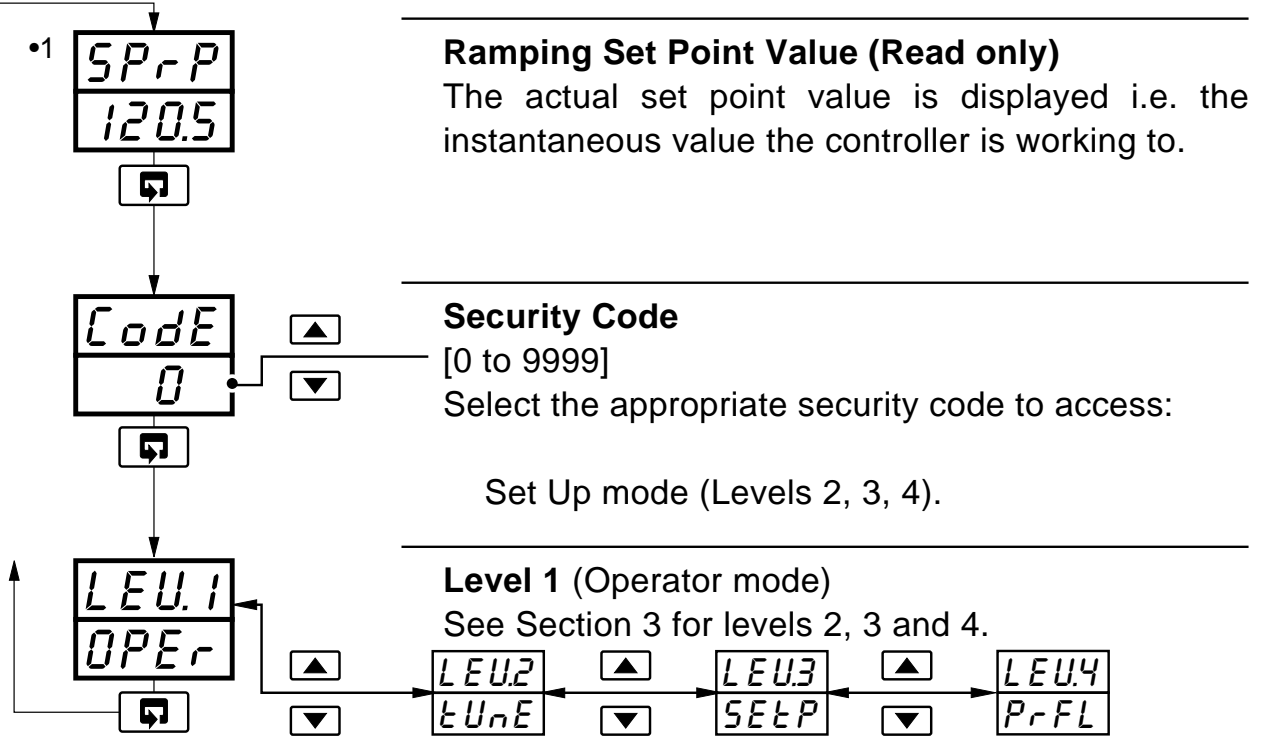


- 1 Not displayed if the ramping set point facility is turned off – refer to Section 3.4.





2.5 Multiple Fixed Set Points Controller

If the Multiple Fixed Set Points Controller type is selected during configuration, four fixed control set points can be set – see Section 4.4.

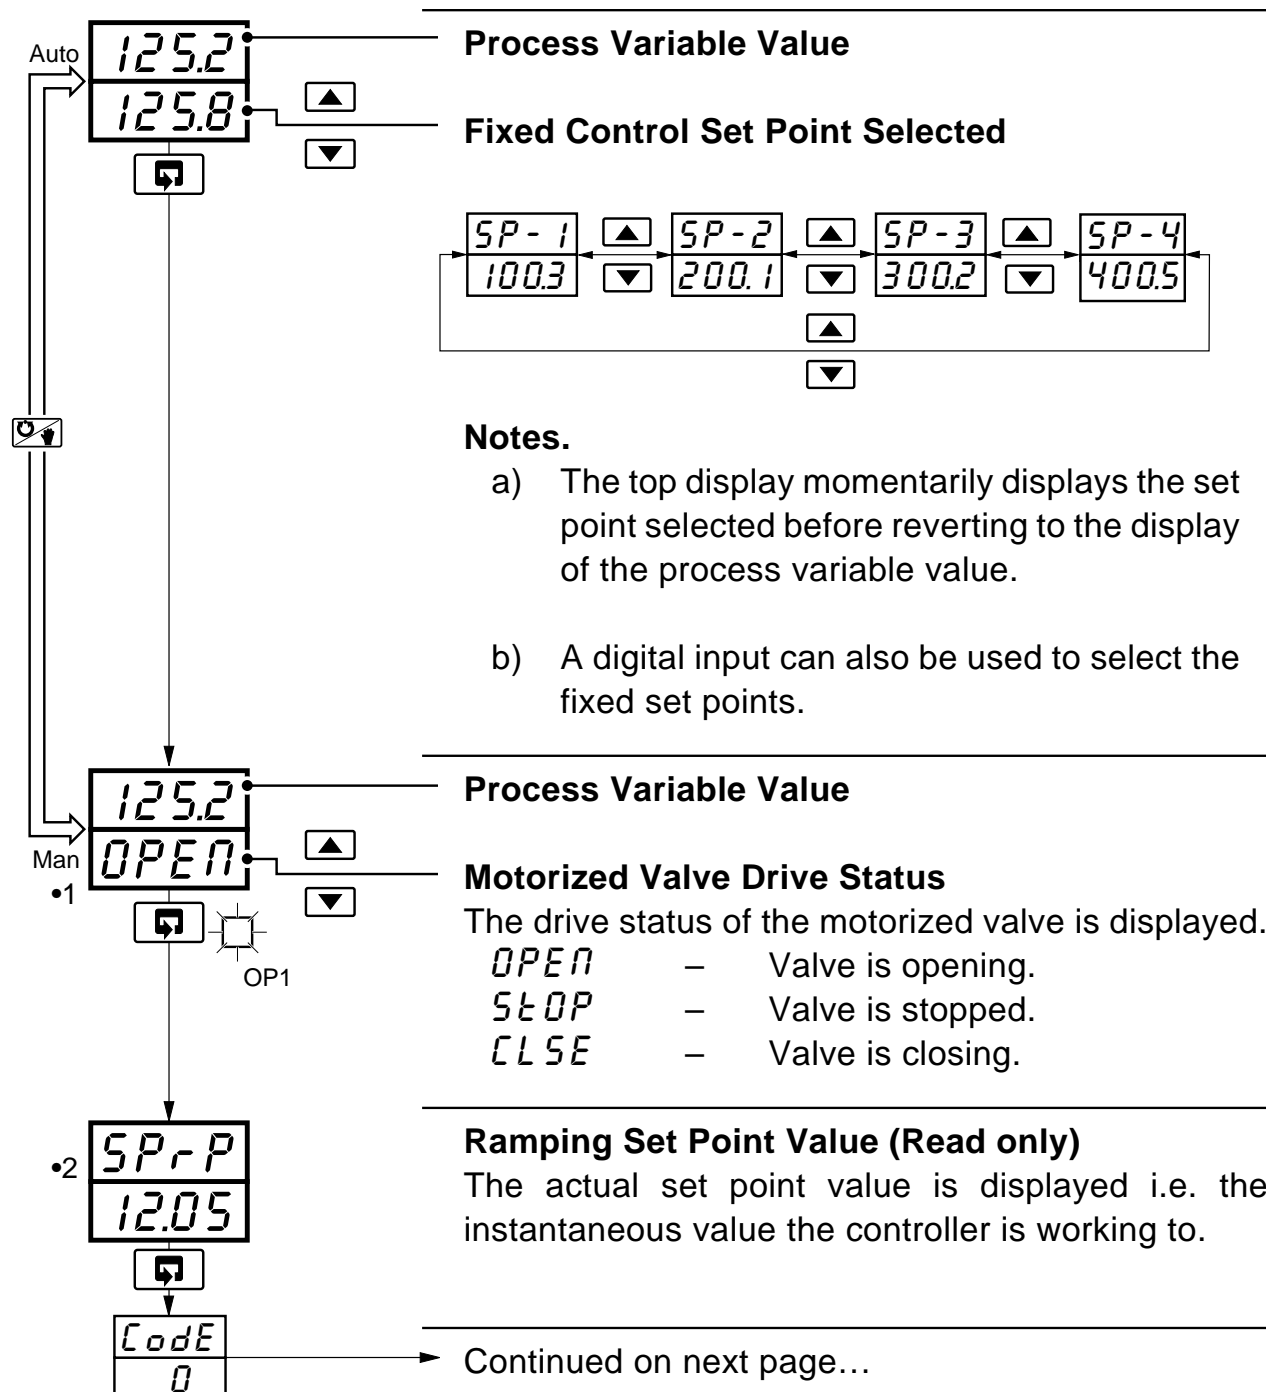


- 1 The Valve Drive Status is adjustable in Manual mode only
- 2 Not displayed if the ramping set point facility is turned off – refer to Section 3.4.





...2.5 Multiple Fixed Set Points Controller

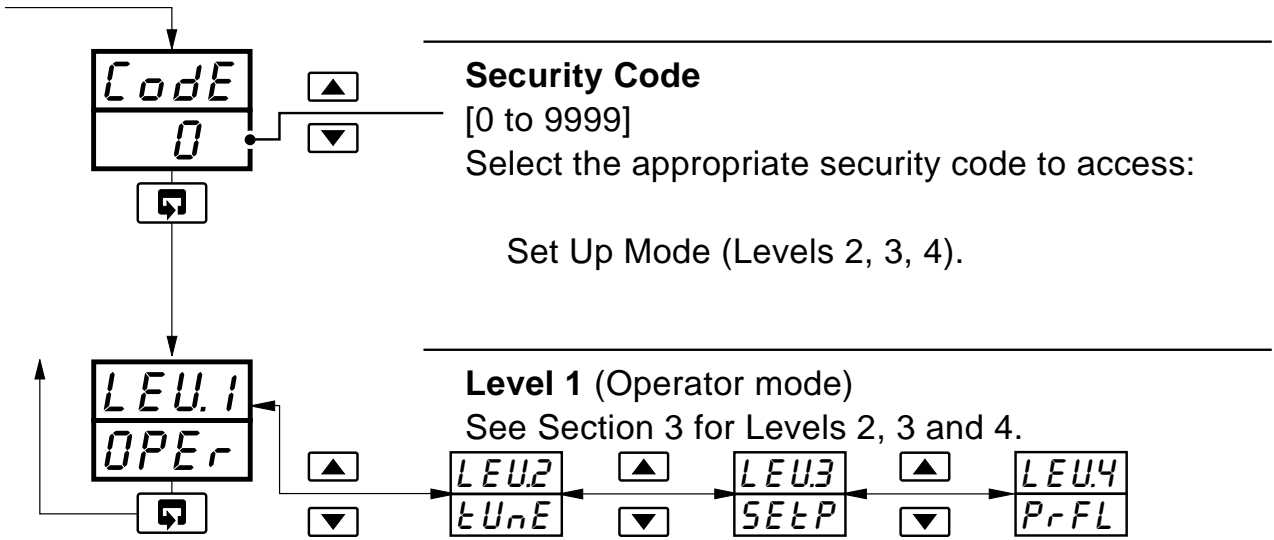





3 SET UP MODE

3.1 Introduction

To access the Set Up Mode (Levels 2, 3 and 4) the correct password must be entered in the security code frame (the default password code is 0). Refer to the fold-out sheet at the back of this manual for the contents of these levels.

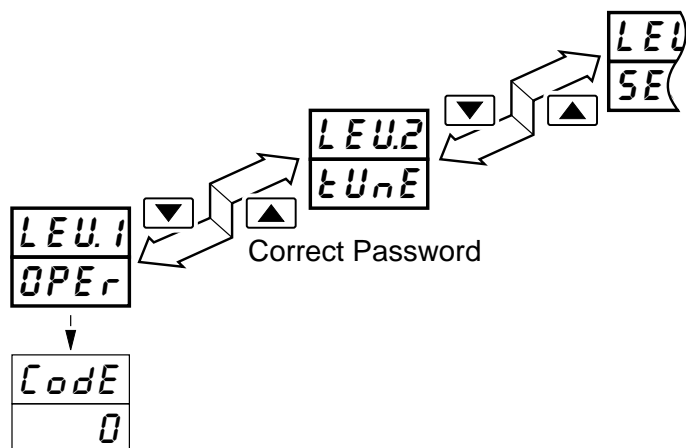

Refer to the fold-out sheet
for the contents of each level






3.2 Motorized Valve Control – Fig. 3.1

The V100 is a 'boundless' process controller which provides an output that is effectively the time derivative of the required regulator position, i.e. the controller signals the regulator, not where to go to (position derivative), but in which direction to travel and how far to move, by a series of integral action pulses. Thus, the controller does not need to know the absolute regulator position and is unaffected when regulator reaches the upper or lower limit, as determined by the regulator's limit switches (giving rise to the term 'boundless').

When a deviation from set point is introduced the regulator is driven, for a length of time equivalent to the proportional step. The regulator is then driven by integral action pulses until the deviation is within the deadband setting.

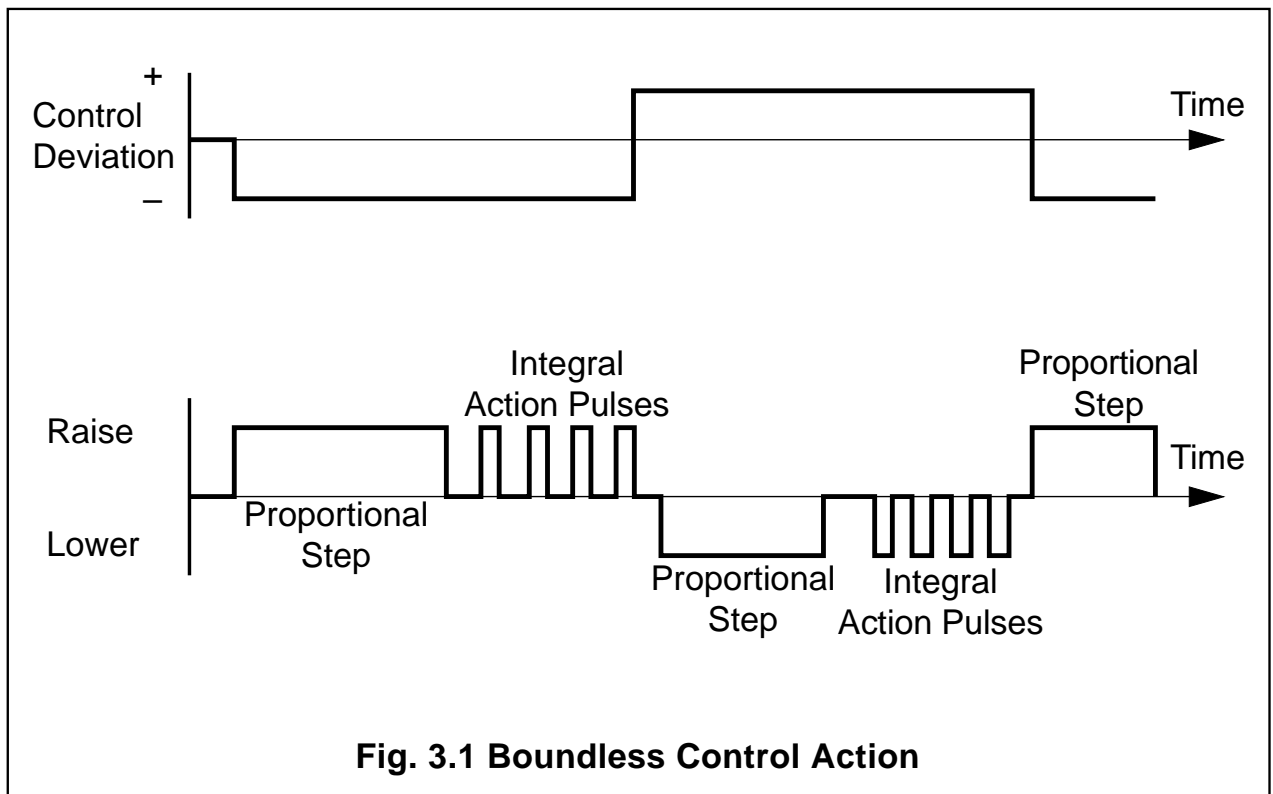



3.2.1 Calculation for Control Pulses, Steps and Deviation (Boundless Control only)

The following calculations, carried out by the instrument, are shown for guidance when setting deadband/travel time values. They can be used to check the suitability of boundless control for a particular application.

Minimum 'ON' time of integral action pulses (for a fixed control deviation).

$$= \frac{\text{Travel Time} \times \text{Deadband \%}}{\% \text{ Proportional Band}} \quad (\text{in seconds})$$

Minimum (approximate) time between integral action pulses (for a fixed control deviation)

$$= \frac{\text{Integral Action Time} \times \text{Deadband \%}}{2 \times \% \text{ Control Deviation}} \quad (\text{in seconds})$$

Duration of the proportional step

$$= 2 \times \left[\frac{\% \text{ Control Deviation}}{\% \text{ Proportional Band}} \right] \times \text{Travel Time in Seconds}$$


$$\% \text{ Control Deviation} = \frac{\text{Set Point} - \text{Process Variable}}{\text{Eng Hi} - \text{Eng Lo}} \times 100$$

$$\% \text{ Deadband} = \frac{\text{Deadband}}{\text{Eng Hi} - \text{Eng Lo}} \times 100$$





3.3 Tuning (Level 2)

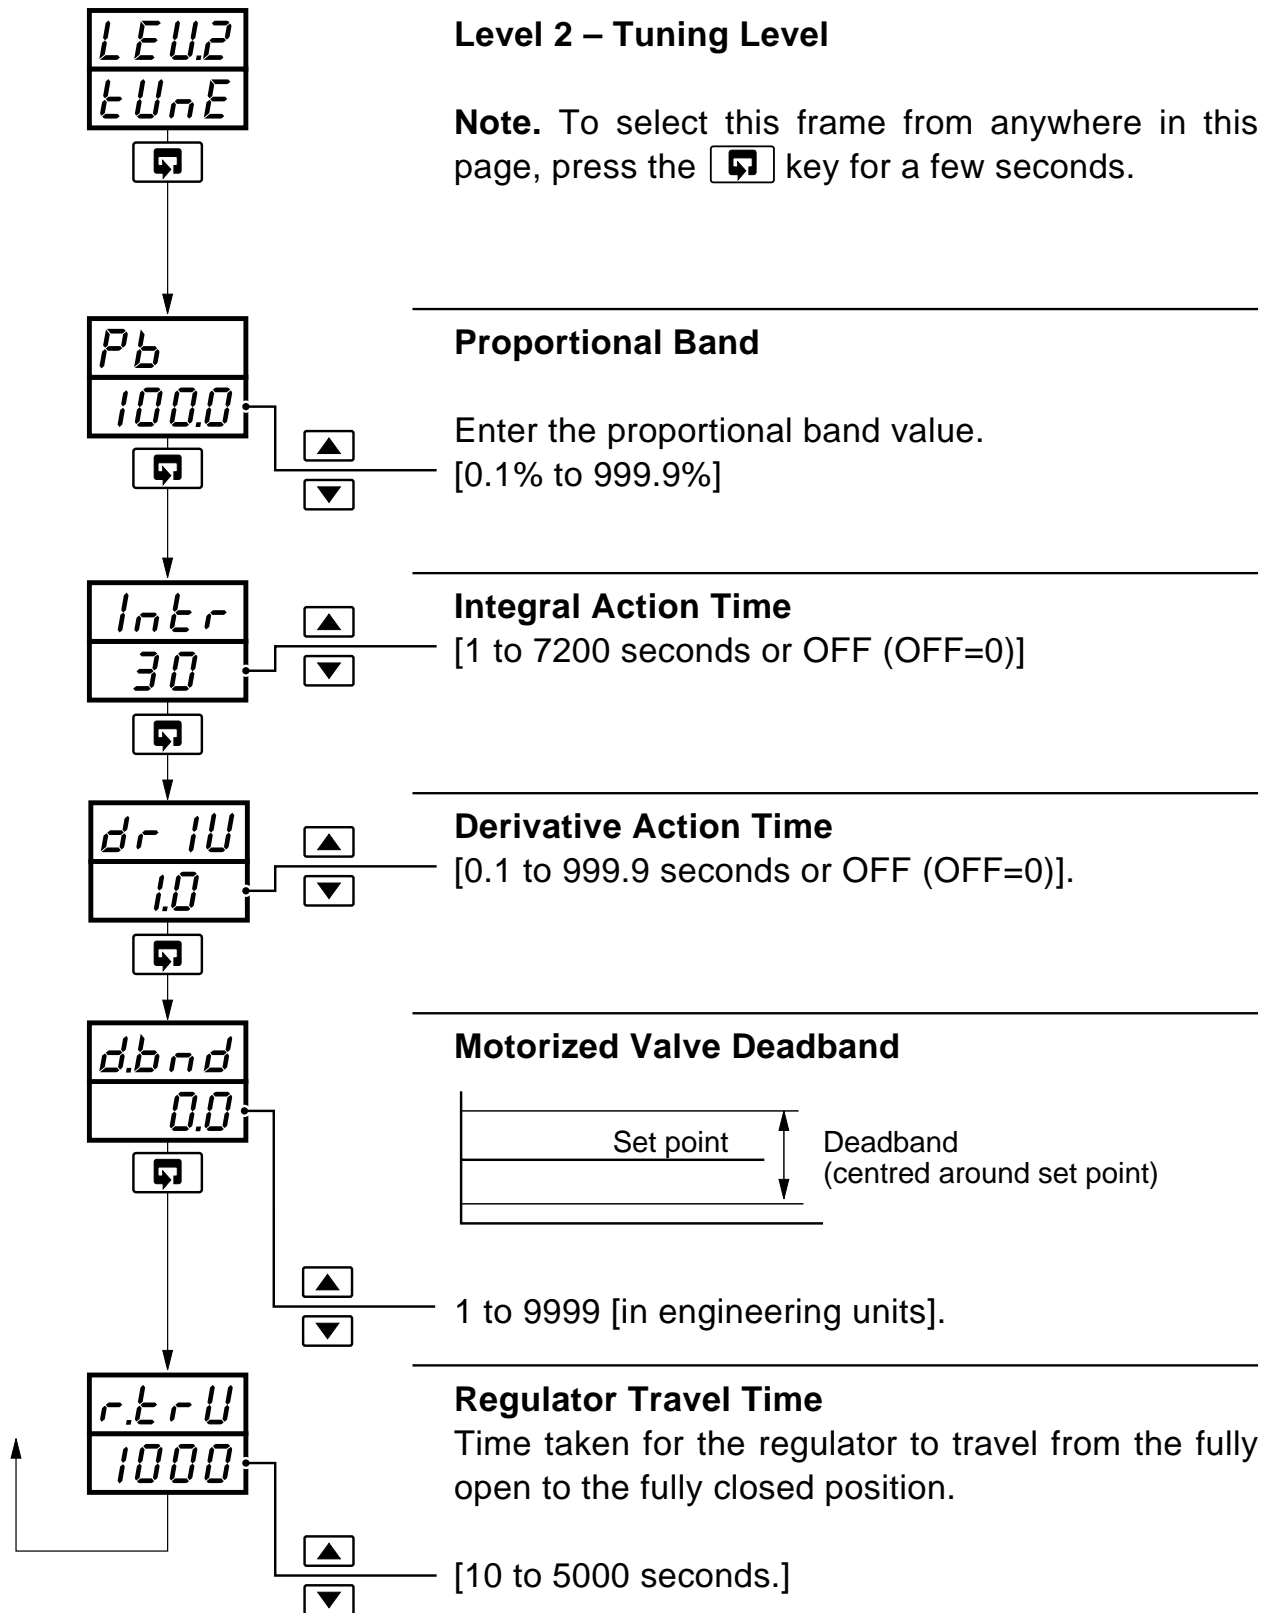



3.4 Set Points (Level 3)

LEU3
SELP



LSPE
125.8



•1

rSP.n
145.8




R hP
800.0



R hY
270.0

Level 3 – Set Points Level

Note. To select this frame from anywhere in this page, press the  key for a few seconds.

Local Set Point Value

[Within set point high and low limits, in engineering units]

Remote Set Point Selection

Set Point Type:

- rSP.y – remote set point
- rSP.n – local set point

Remote set point value.

Alarm 1 Trip Point

Alarm type:

- R hP = High process alarm
- R lL P = Low process alarm
- R h d = High deviation alarm
- R lL d = Low deviation alarm

Trip Point:

Process & deviation alarms [in engineering units]


Continued on next page.

•1 Only displayed if the remote set point option is selected.





...3.4 Set Points (Level 3)

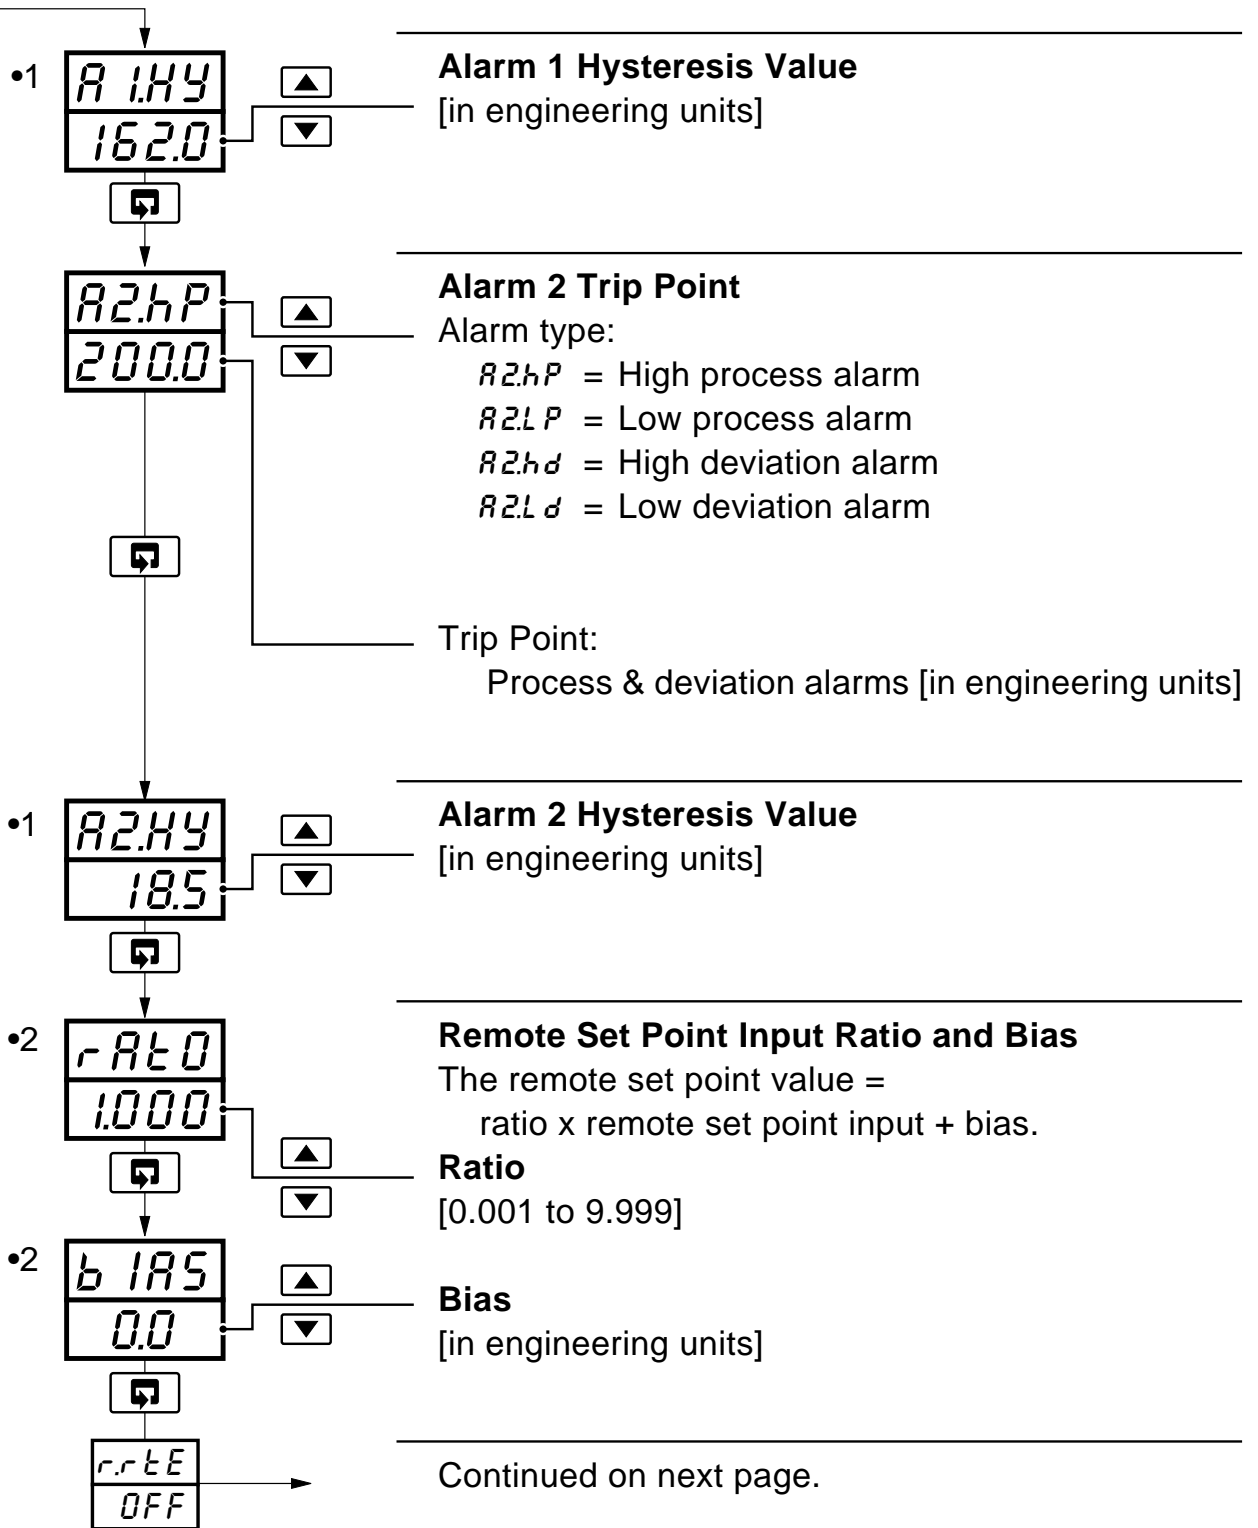


- 1 Only displayed if custom alarm hysteresis is selected – see section 4.3.2,
- 2 Only displayed if the remote set point option is selected.





...3.4 Set Points Level

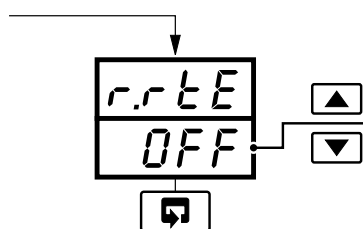


Ramp Rate (for ramping set point facility)


[1 to 9999 engineering units per hour, or OFF]

The ramping set point facility can be used to prevent a large disturbance to the control output when the set point value is changed. This only applies to the local and multiple fixed set points.

Note. For remote set points, the ramp rate is applicable only when switching from remote to local, not from local to remote.

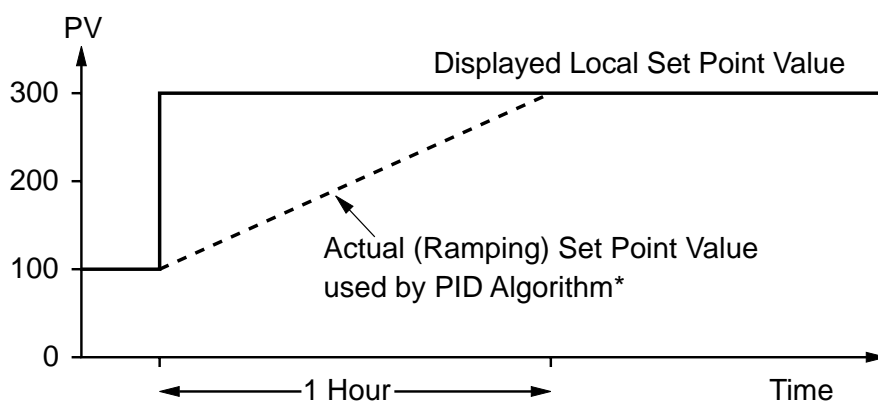

* e.g. Ramp Rate = 200 Increments/Hour



Offset Adjustment



An offset can be applied to the process variable input to enable spot calibration or the removal of system errors.

[±10% of engineering range in engineering units]




3.5 Profile (Level 4)

A four segment ramp/soak profile facility is provided. This level can only be accessed if the profile option is selected in the configuration level. The four segments are fixed as ramps or soaks as follows:

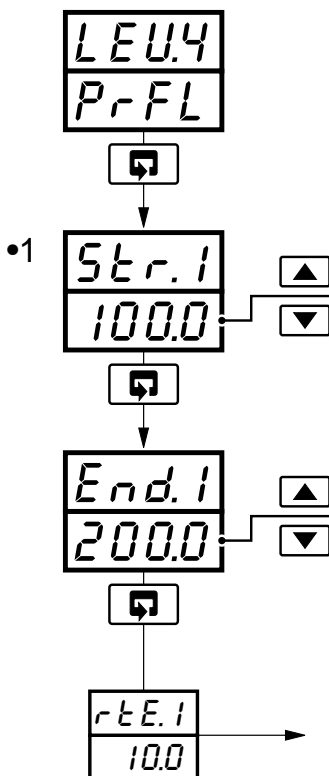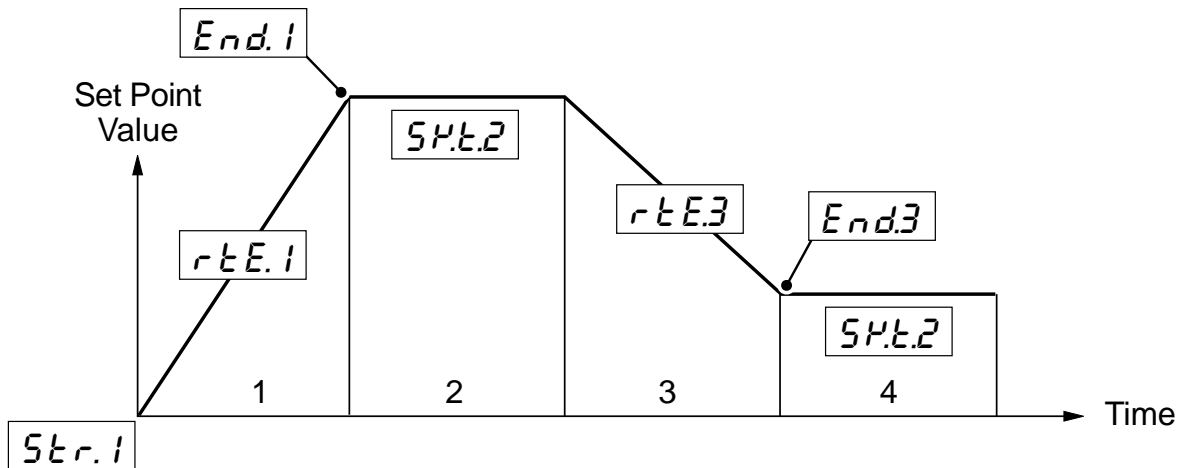

Level 4 – Profile Level

Note. To select to this frame from anywhere in this page, press the  key for a few seconds.

Start value for 1st Segment (ramp).
[Within display range (in engineering units)]

Enter the start value required.

End Value for 1st Segment (ramp).
[Within display range (in engineering units)]

Enter the end value required.

Continued on next page.

•1 With the self-seeking set point facility enabled, the first ramp starts at the current process variable value instead of the start value for the 1st segment.





...3 SET UP MODE

...3.5 Profile (Level 4)

•1

r.t.E.1
40.00

▲
▼

Ramp Rate for 1st Segment.
[Engineering units*]

Enter the ramp rate required.
* The time option Eng Units/hr or Eng Units/min is set in the configuration level – see section 4.3.2.

Set Point Value

80
40
0

1st Segment

Time

← 2 Min →

Example. Required Ramp Rate 40°C/min
Ramp Rate set to 40, Time Option set to 'Min' – see section 4.3.2

S.P.t.2
60.00

▲
▼

Soak Time for 2nd Segment.
[0 to 999.9 minutes or hours]*

End.3
100.0

▲
▼

End Value for 3rd Segment (ramp).
[Within display range (in engineering units)]

r.t.E.3
20.00

▲
▼

Ramp Rate for 3rd Segment.
[Engineering units/hour or /minute]*

* Depending on the time option selected in the configuration level.

S.P.t.4
30.00


Continued on next page.

- 1 The engineering value is shown with an extra decimal place (up to a maximum of 3) for greater accuracy in setting the ramp rate.





...3.5 Profile (Level 4)

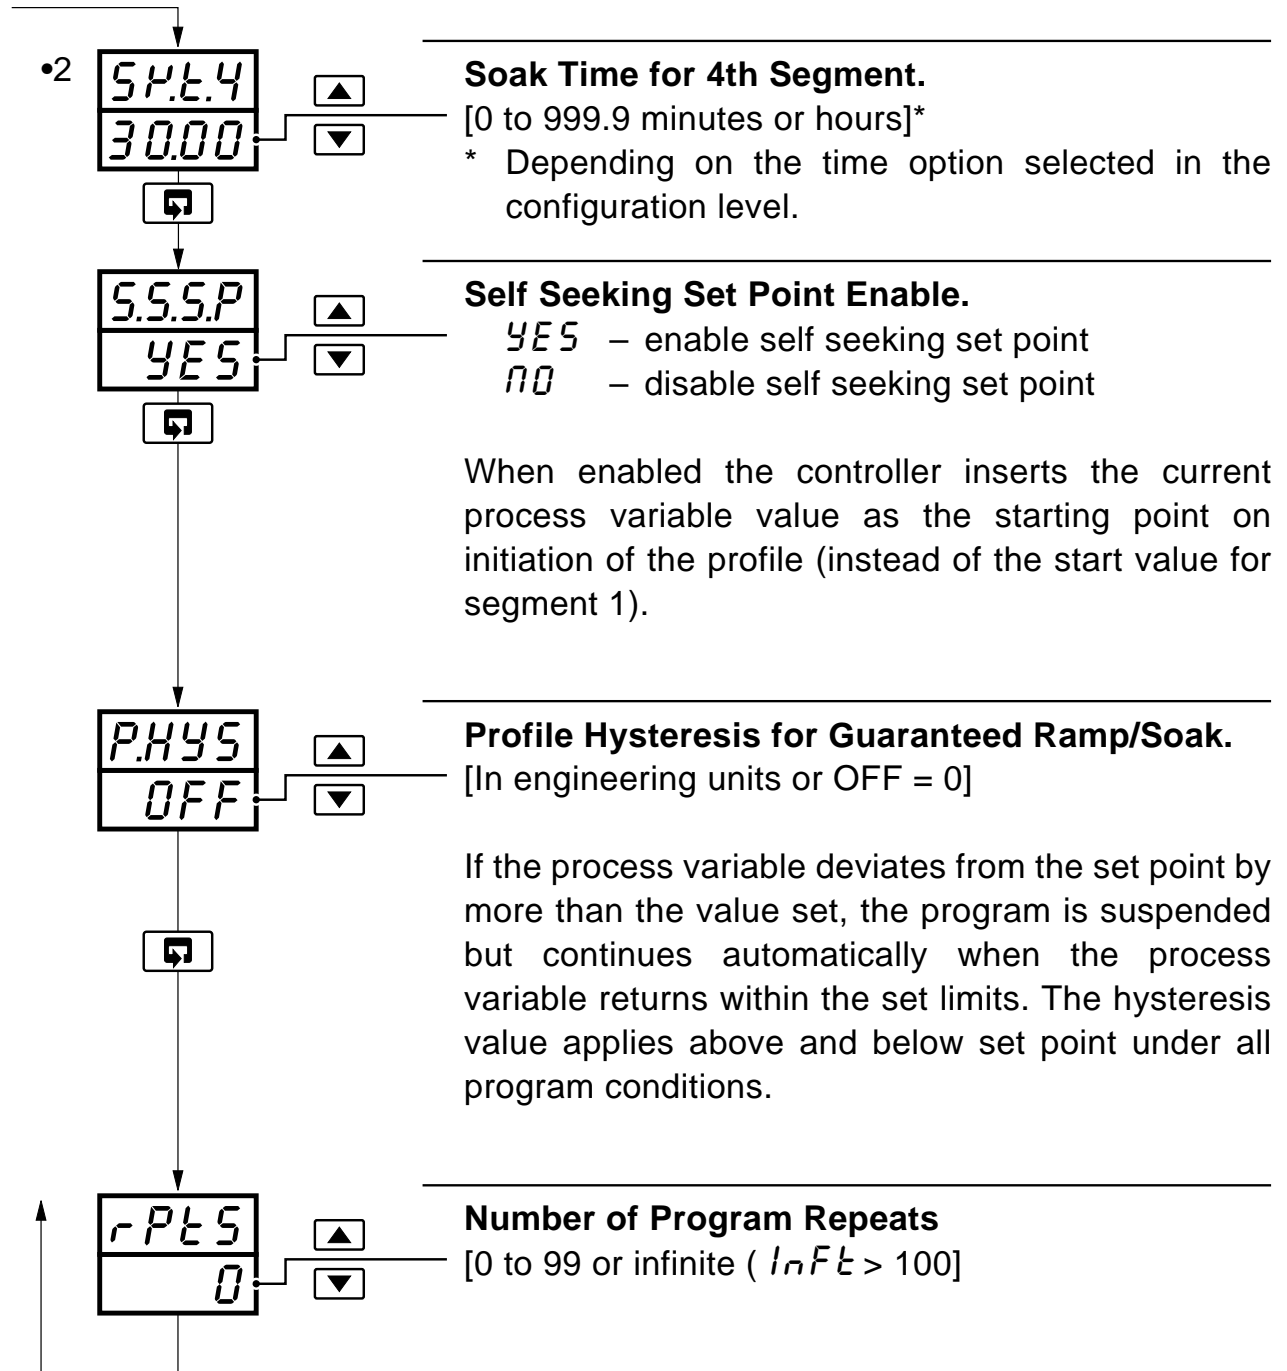

•2 The engineering value is shown with an extra decimal place (up to a maximum of 3) for greater accuracy in setting the ramp rate.



4 CONFIGURATION MODE

4.1 Introduction

The Configuration Mode comprises two levels (5 and 6) as shown in Fig. 4.2.

Level 5 is divided into four frames. For most simple applications it is only necessary to set up the parameters in the first frame.

Note.

When in the configuration level:

- All the l.e.d. indicators flash.
- All relays and logic outputs are turned off.
- The analog output reverts to 0% (4mA) output level.

4.2 Accessing the Configuration Mode – Fig. 4.1

To access the Configuration Mode set the security switch to the 'Configure' position (levels 1 to 4 cannot be accessed from this setting). When the configuration parameters are programmed, reset the security switch to the 'Normal' position and the Operating page is displayed automatically .

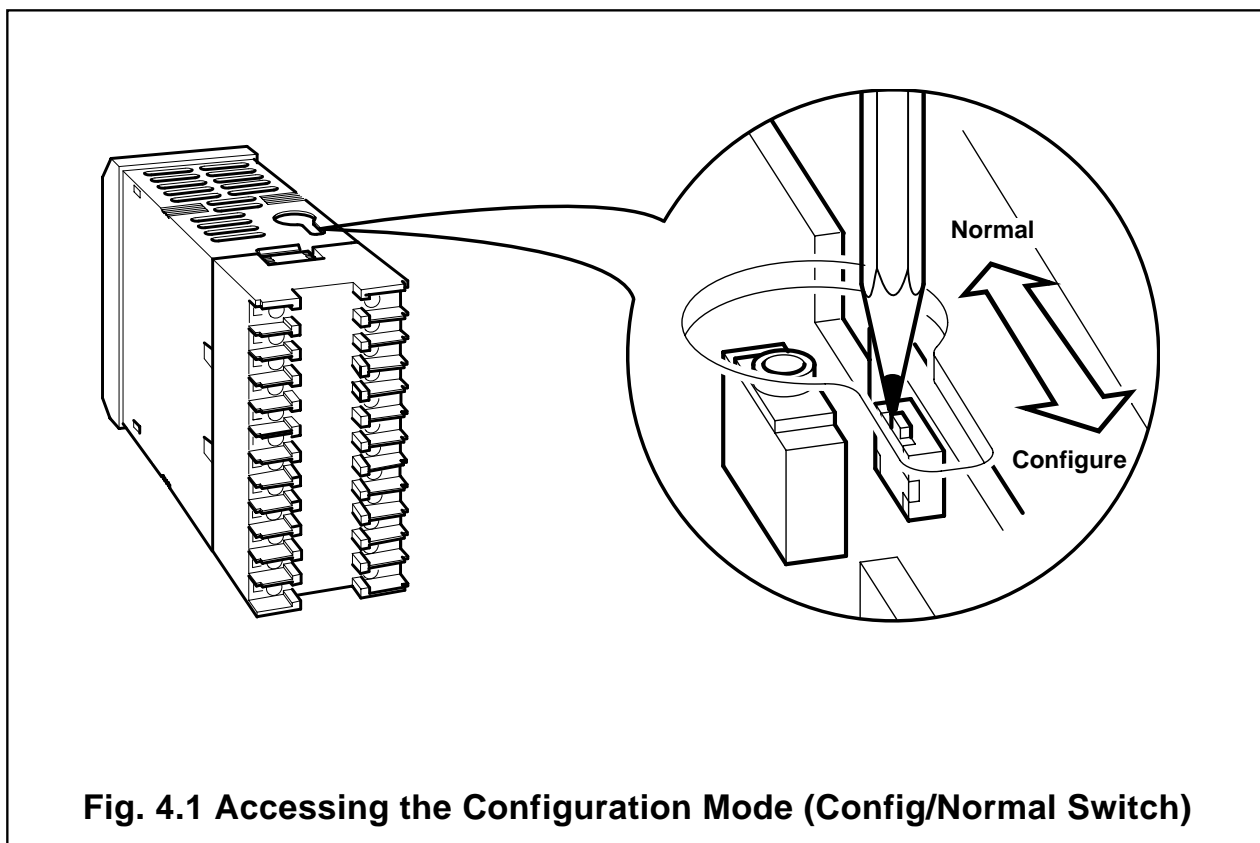


Fig. 4.1 Accessing the Configuration Mode (Config/Normal Switch)

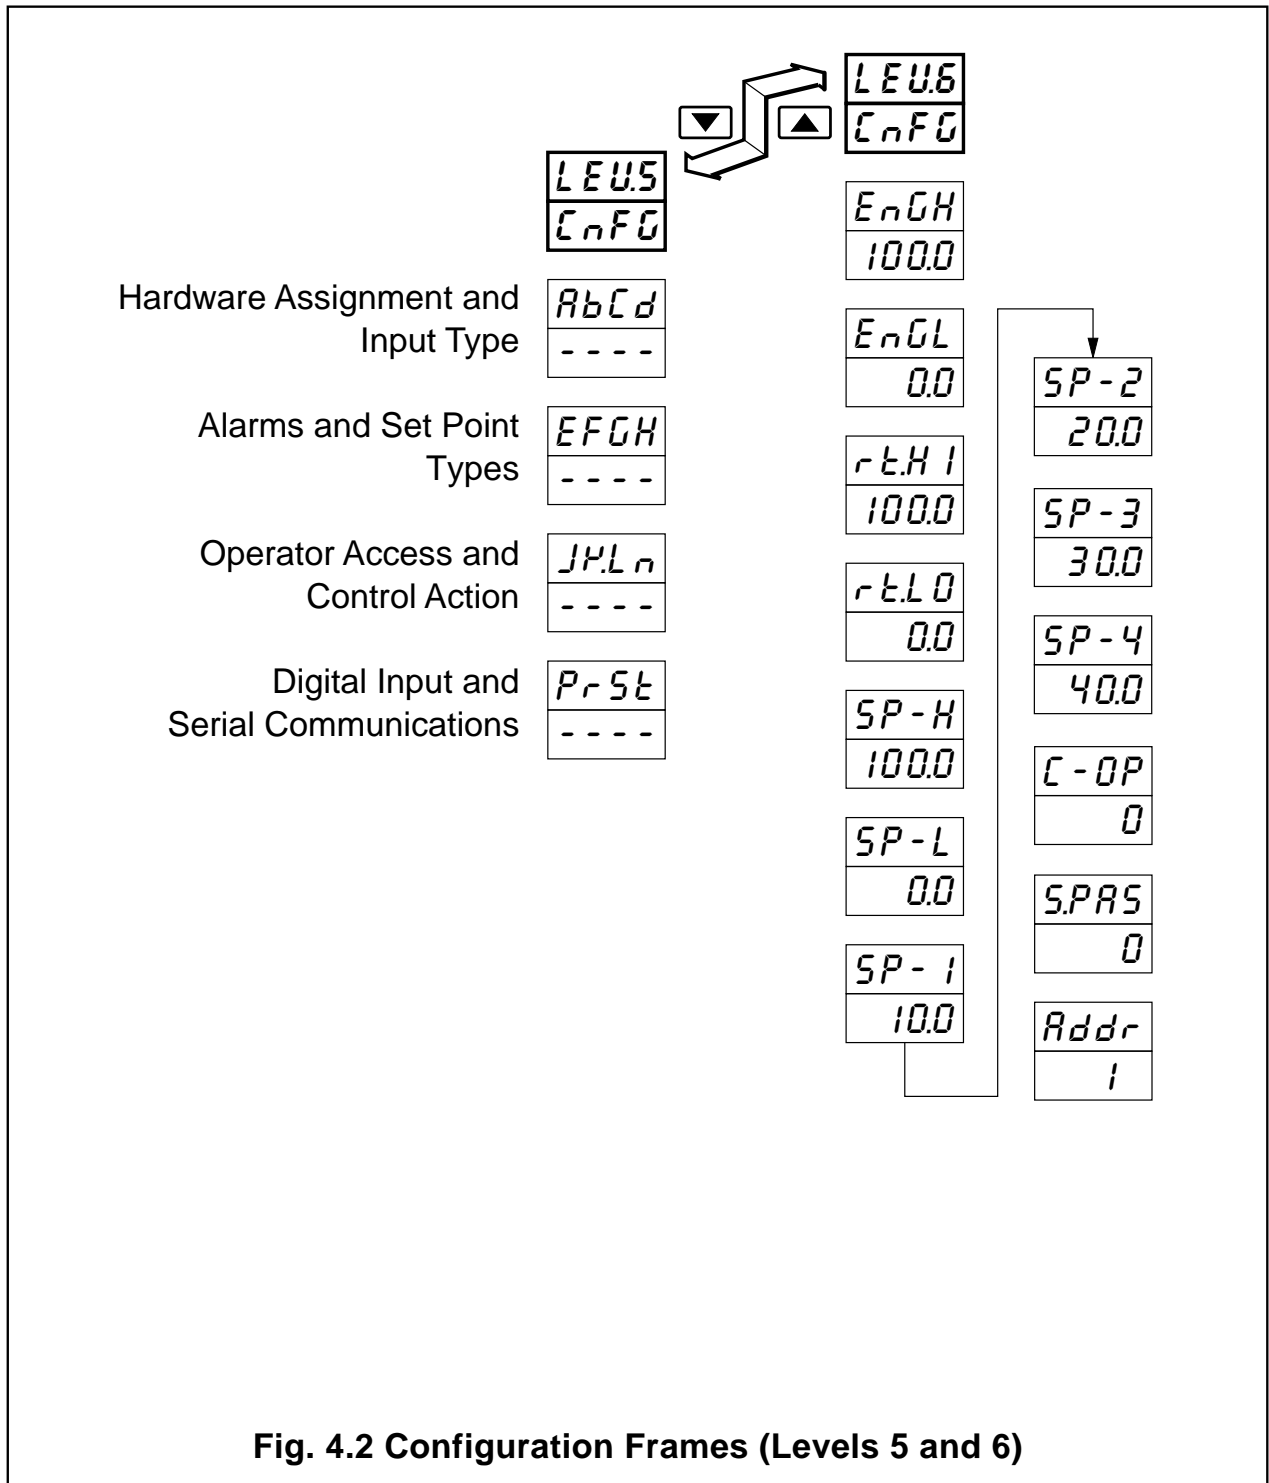


Fig. 4.2 Configuration Frames (Levels 5 and 6)





4.3 Basic Hardware and Configuration (Level 5)

4.3.1 Hardware Assignment and Input Type – Fig. 4.3

LEU5
CnFG




AbCd
6400



EFGH

Level 5 –Configuration

Note. To select this frame from anywhere in this page, press the  key for a few seconds.

'ABCD' Settings

AbCd
6400

AbCd
6400

AbCd
6400

AbCd
6400

The parameter to be changed is indicated by the letter which is flashing. Parameter options are shown in Fig. 4.3.

- A* = Hardware configuration
- b* = Input type and range
- C* = Temperature units
- d* = Process variable display decimal places

Notes.

Note 1. When the input type (parameter *b*) is changed, the range is set automatically to the maximum permissible for the input type selected.

Note 2. For custom settings contact the local distributor.

Continued on page 30.





A – Hardware Configuration


Frequency	Rly 1	Rly 2	Rly 3*	Logic O/P	An. O/P 1	Control Type
50 Hz 60 Hz	Open valve	Close valve	Alarm 1	Alarm 2	PV Rtx	Boundless
<i>E</i> <i>F</i>						
<i>U</i>	Custom	Custom	Custom	Custom	Custom	Custom

* Only available if option boards 2 or 3 are fitted



B – Input Type and Range Configuration

Display		Display	
<i>b</i>	THC Type B	<i>1</i>	0 to 20 mA
<i>E</i>	THC Type E	<i>2</i>	4 to 20 mA
<i>J</i>	THC Type J	<i>3</i>	0 to 5 V
<i>K</i>	THC Type K	<i>4</i>	1 to 5 V
<i>n</i>	THC Type N	<i>5</i>	0 to 50 mV
<i>r</i>	THC Type R	<i>7</i>	4 to 20 mA (square root lineariser)
<i>S</i>	THC Type S	<i>U</i>	Custom Configuration
<i>t</i>	THC Type T		
<i>P</i>	PT100 RTD		



C – Temperature Units

Display	Temperature Units
<i>C</i>	Degrees C*
<i>F</i>	Degrees F*
<i>0</i>	No temperature units




D – Process Variable Display Decimal Places

Display	
<i>0</i>	xxxx
<i>1</i>	xxx . x
<i>2</i>	xx . xx
<i>3</i>	x . xxx

* Temperature inputs only


Fig. 4.3 Hardware Assignment and Input Type






4.3.2 Alarms and Set Point Types – Fig. 4.4


Note. All relays are de-energised in the alarm state.

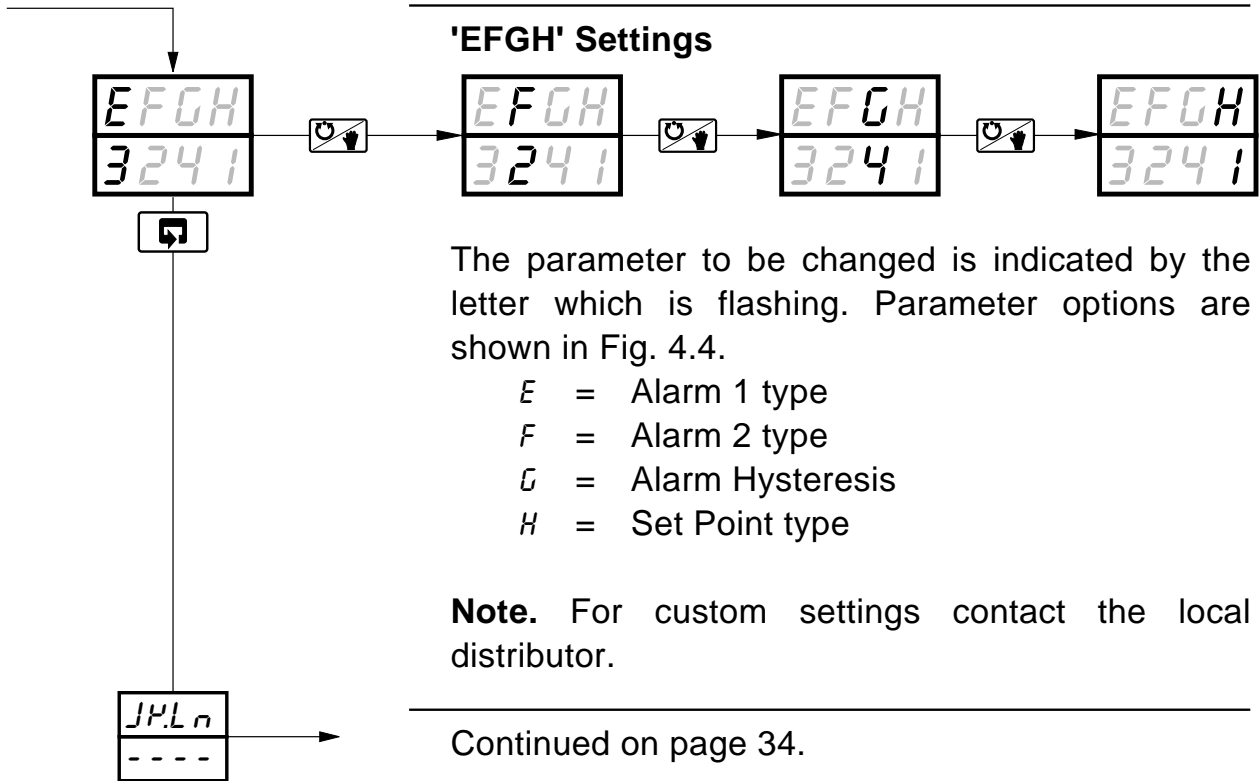



E – Alarm 1 Type*


Display	
0	None
1	High Process
2	Low Process
3	High Deviation
4	Low Deviation



F – Alarm 2 Type*

Display	
0	None
1	High Process
2	Low Process
3	High Deviation
4	Low Deviation

* Refer to Figs. 4.5 and 4.6 for alarm action




G – Alarm Hysteresis

Display	
0	None
1	0.1%
2	0.2%
3	0.5%
4	1.0%
5	2.0%
6	5.0%
U	Custom

Value in % of engineering range

Value in engineering units – see **Note 1**

Note 1. When custom alarm hysteresis is selected, the alarm hysteresis values are set individually in the **set up level** – see section 3.3



H – Set Point Type


Display	
0	Local Set Point Only
1	Local + Remote Set Point (no Remote Set Point Tracking)**
2	Local + Remote Set Point (with Remote Set Point Tracking)**
3	Multiple Fixed Set Points
4	Ramp/Soak (Time Units in Minutes)
5	Ramp/Soak (Time Units in Hours)

See **Note 2**

**Only available if option board is fitted. Remote set point input is 4 to 20 mA

Note 2. With remote set point tracking enabled the local set point tracks the remote set point when in the remote set point mode.

Fig. 4.4 Alarms and Set Point Types





...4 CONFIGURATION MODE

...4.3.2 Alarms and Set Point Types – Fig. 4.4

Note. All relays are de-energised in the alarm state.


Process and Deviation Alarms (High/Low) – Figs 4.5 and 4.6

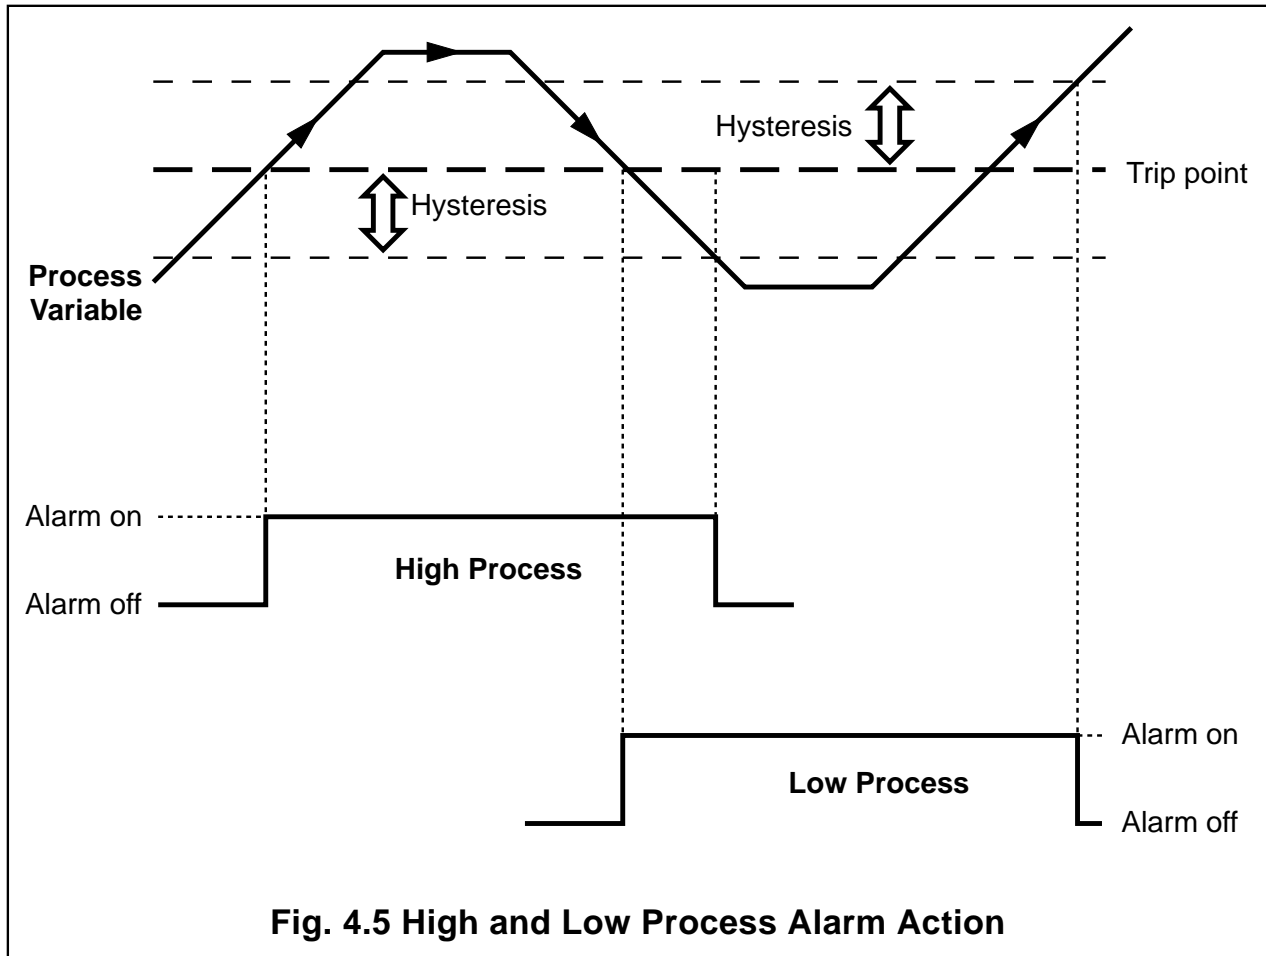

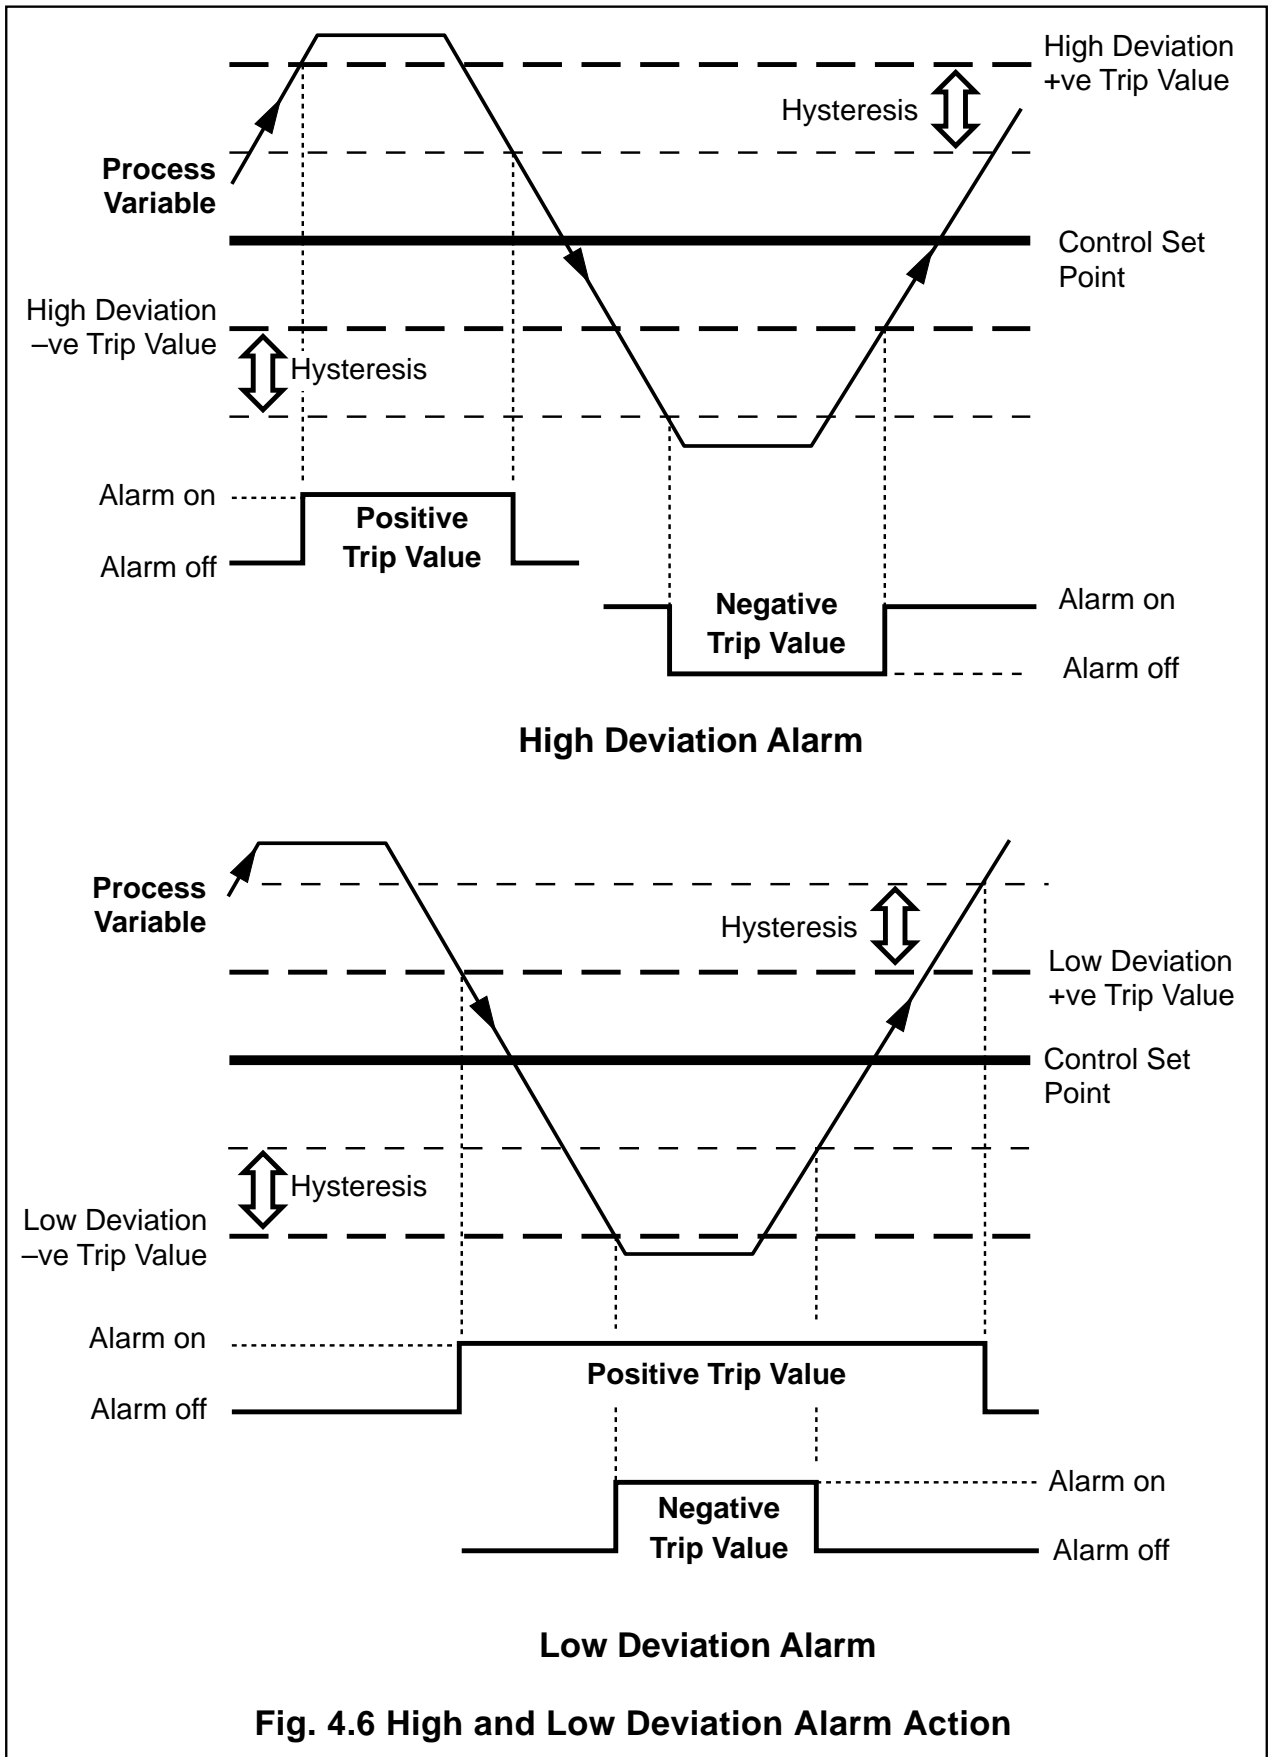



4.3.3 Operator Access and Control Action – Fig. 4.7

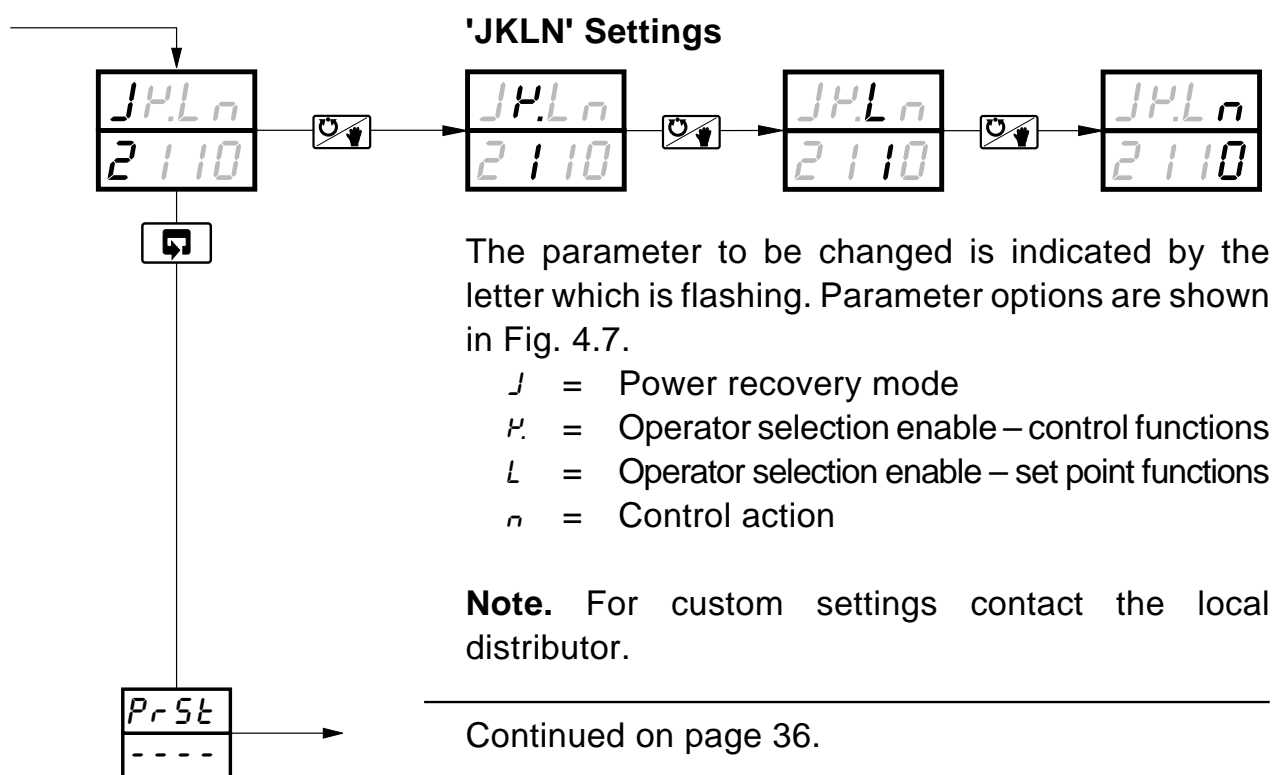

Continued on page 36.



JPLn
2110

J – Power Recovery Mode

Display	Mode
0	Last Mode
1	Manual with last Valve position
2	Manual with Valve fully closed
3	Manual with Valve fully open
4	Auto
U	Custom

JPLn
2110

K – Operator Selection Enable Control Functions

Display	Auto/Manual
0	Enable Auto/Manual
1	Disable Auto/Manual

JPLn
2110

L – Operator Selection Enable – Set Point Functions

Display	Local Set Point Adjustment and Local/Remote Set Point Selection
0	Enable Both Functions
1	Disable Set Point Adjust, Enable Local/Remote Selection
2	Enable Set Point Adjust, Disable Local Remote Function
3	Disable Both Functions

JPLn
2110

N – Control Action


Display	Action
0	Reverse
1	Direct

Fig. 4.7 Operator Access and Control Action






4.3.4 Digital Input and Serial Communications – Fig. 4.8

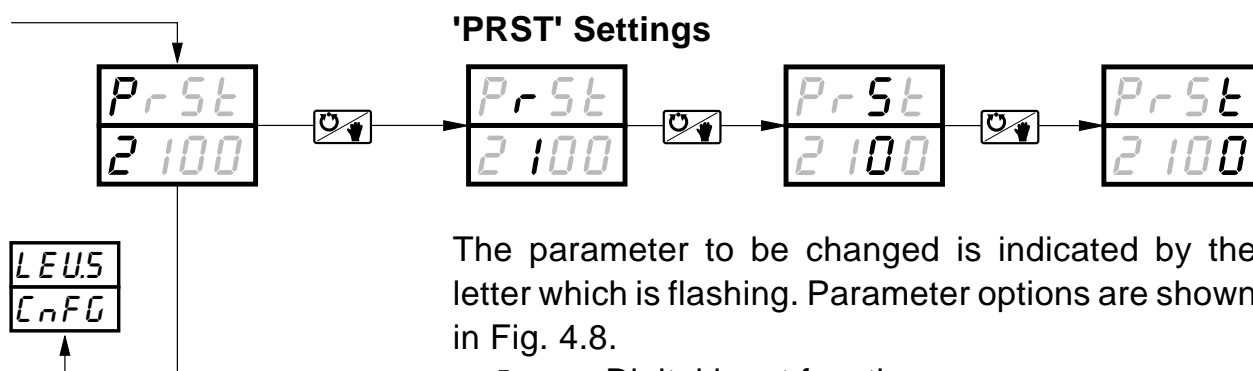

The parameter to be changed is indicated by the letter which is flashing. Parameter options are shown in Fig. 4.8.

- P* = Digital input function
- r* = Analog input digital filter
- S* = Serial communications configuration
- t* = Serial communication parity

Note. For custom settings contact the local distributor.

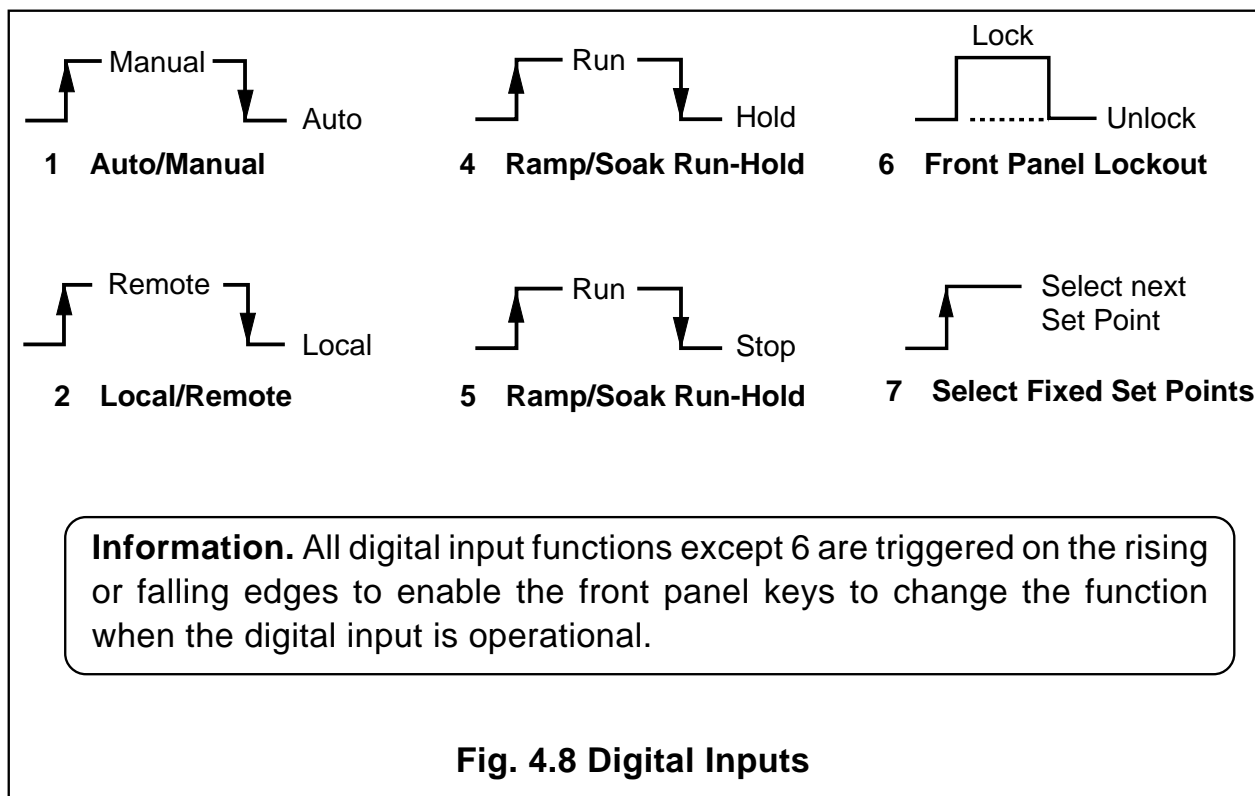



P-5t
2 100

P – Digital Input Functions

Display	Function
0	None
1	Auto/Manual
2	Local/Remote
4	Ramp/Soak Run-Hold
5	Ramp/Soak Run-Stop
6	Front Panel Lockout
7	Select Fixed Set Points

P-5t
2 100

R – Analog Input Digital Filter

Display	
0	0 seconds
1	1 second
2	2 seconds
5	5 seconds
A	10 seconds
B	20 seconds
C	40 seconds
D	60 seconds

Input filter averages the process variable input values over the time set

P-5t
2 100

S – Serial Communication Configuration

Display	Baud Rate, 2/4 Wire
0	Off
1	2400, 2 Wire
2	2400, 4 Wire
3	9600, 2 Wire
4	9600, 4 Wire

P-5t
2 100


T – Serial Communications Parity

Display	
0	None
1	Odd
2	Even

Fig. 4.9 Digital Input and Serial Communications




4.4 Ranges and Passwords (Level 6)

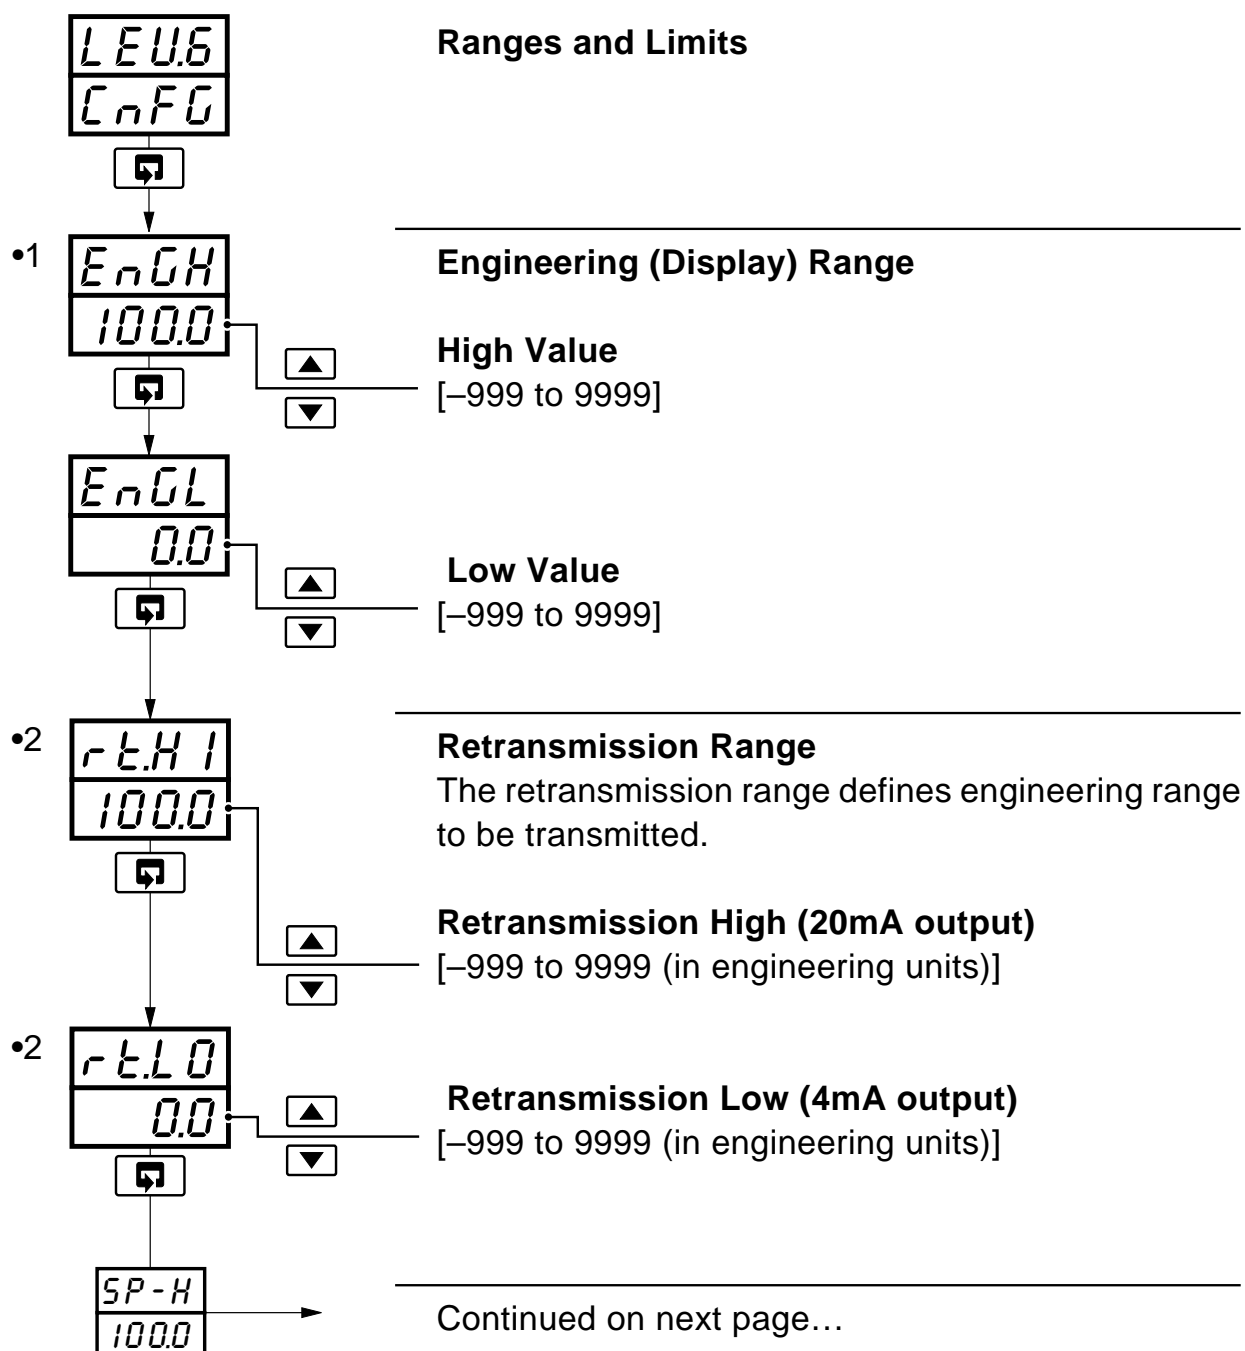

- 1 The engineering range high and low values are automatically set to the maximum allowed value when thermocouple or RTD is selected in the configuration level – see Section 4.3.1.
- 2 Only displayed if the analog output is configured to retransmit the process variable or control set point value.




...4.4 Ranges and Passwords (Level 6)

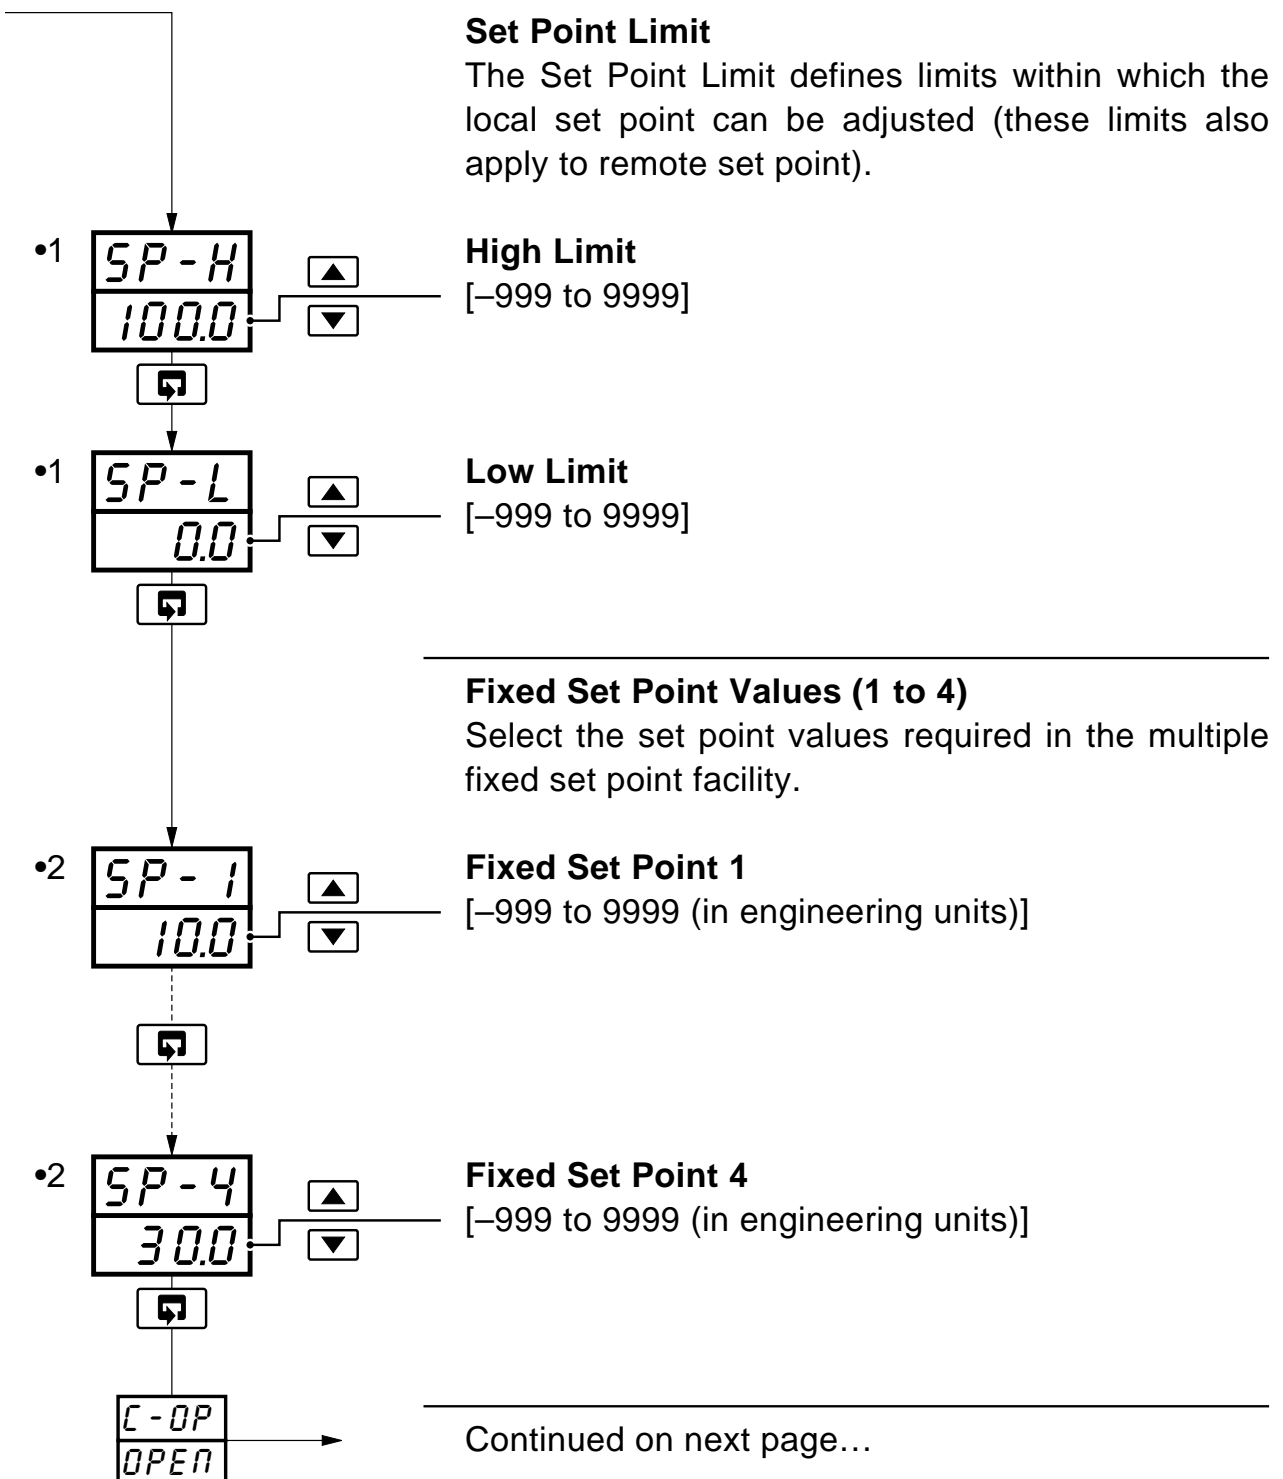


- 1 This limit applies to the local and remote set point values.
- 2 Only displayed if the multiple fixed set point facility is selected.





...4 CONFIGURATION MODE


...4.4 Ranges and Passwords (Level 6)

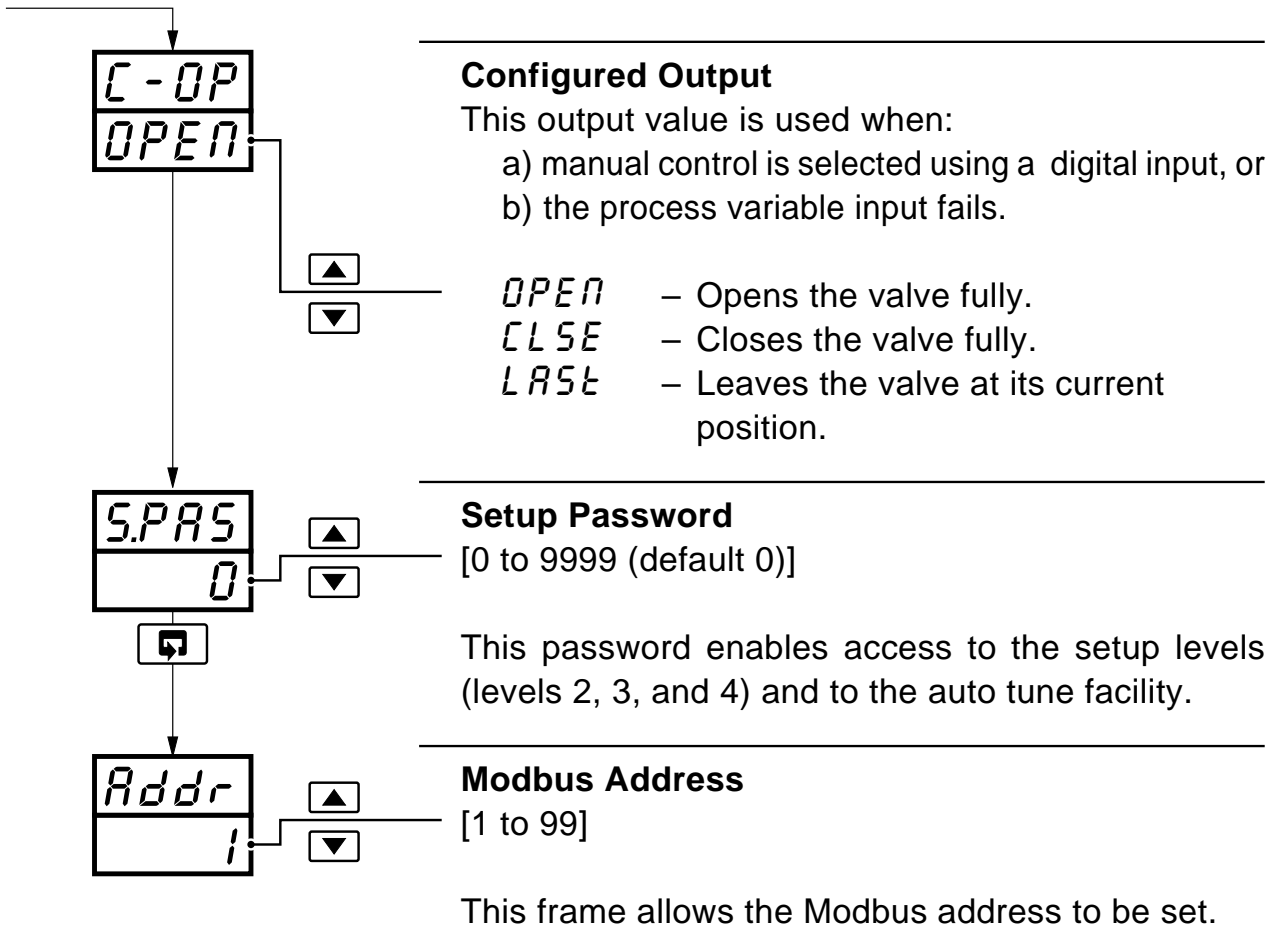

5 INSTALLATION




5.1 Siting – Figs. 5.1 and 5.2

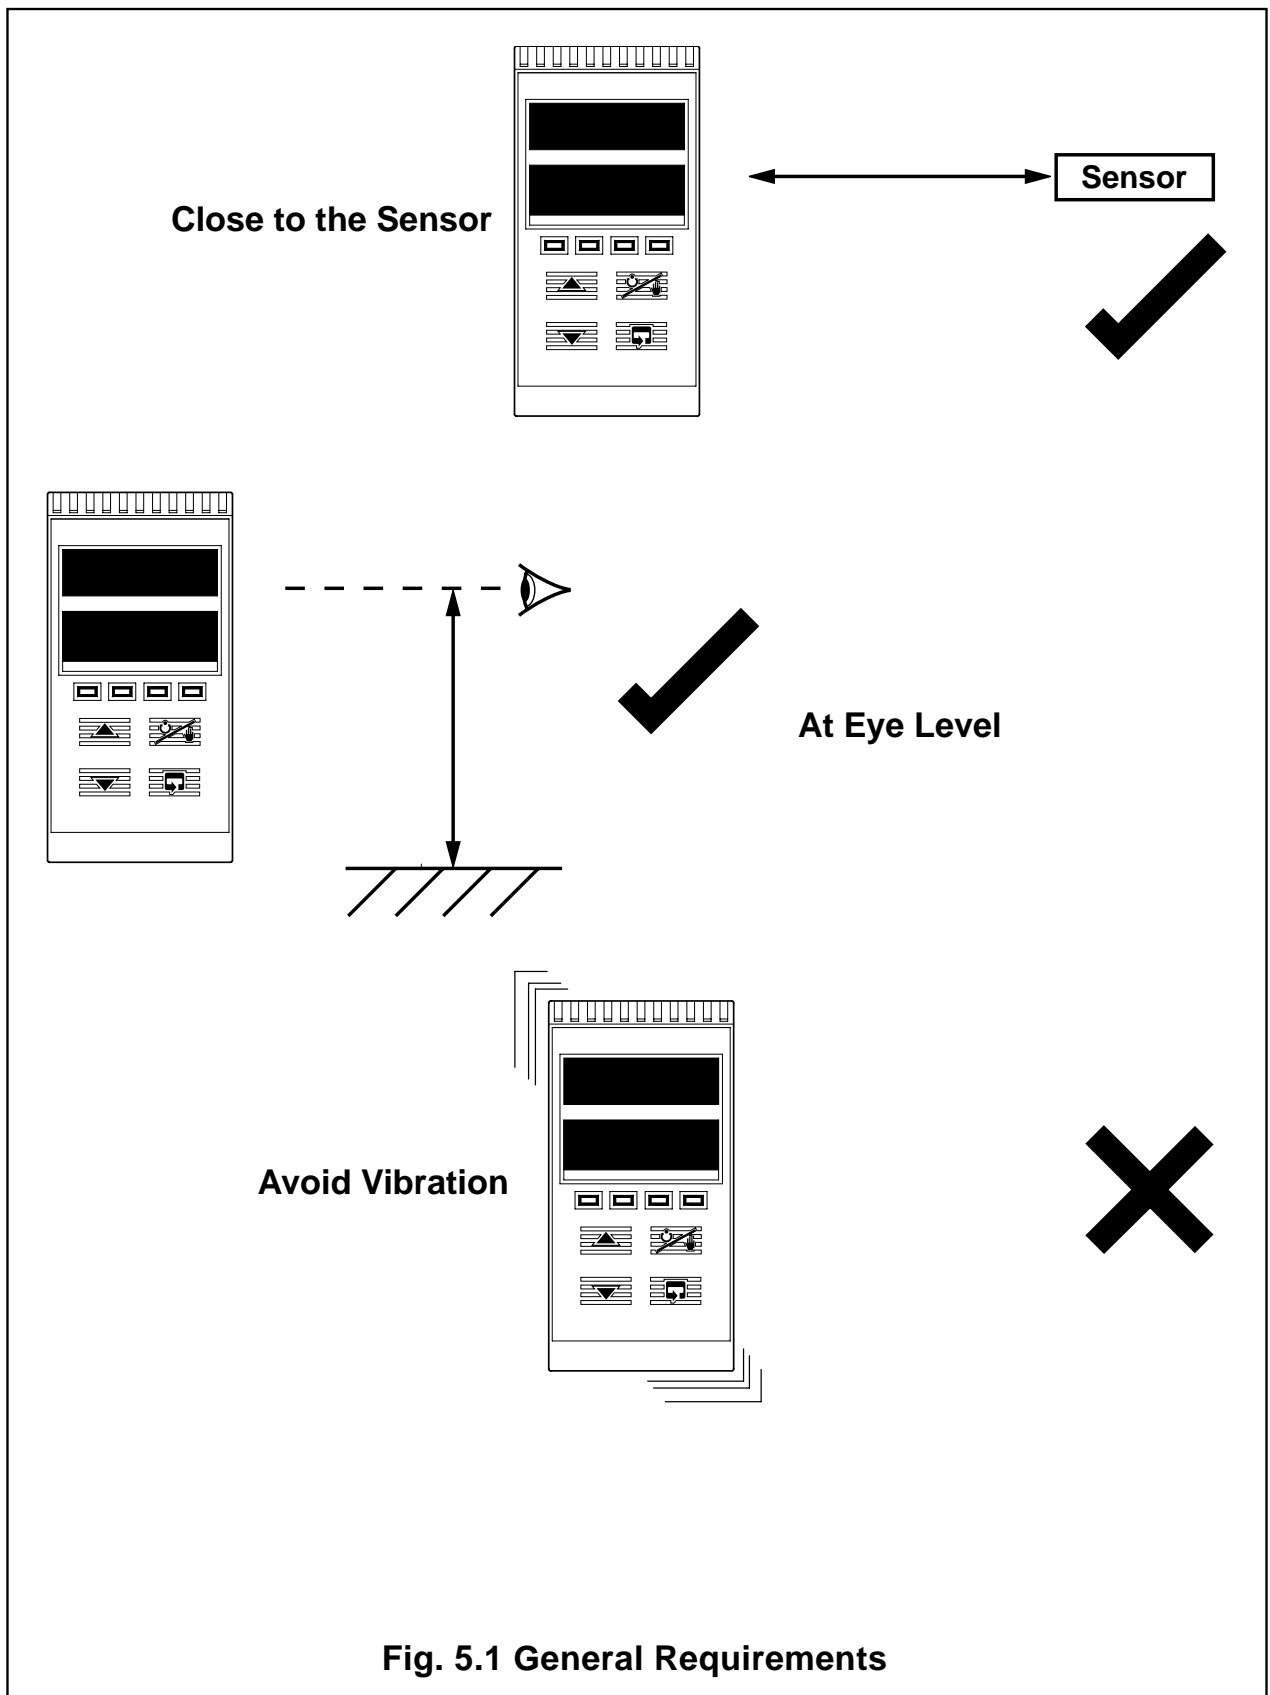



...5 INSTALLATION


...5.1 Siting – Figs. 5.1 and 5.2

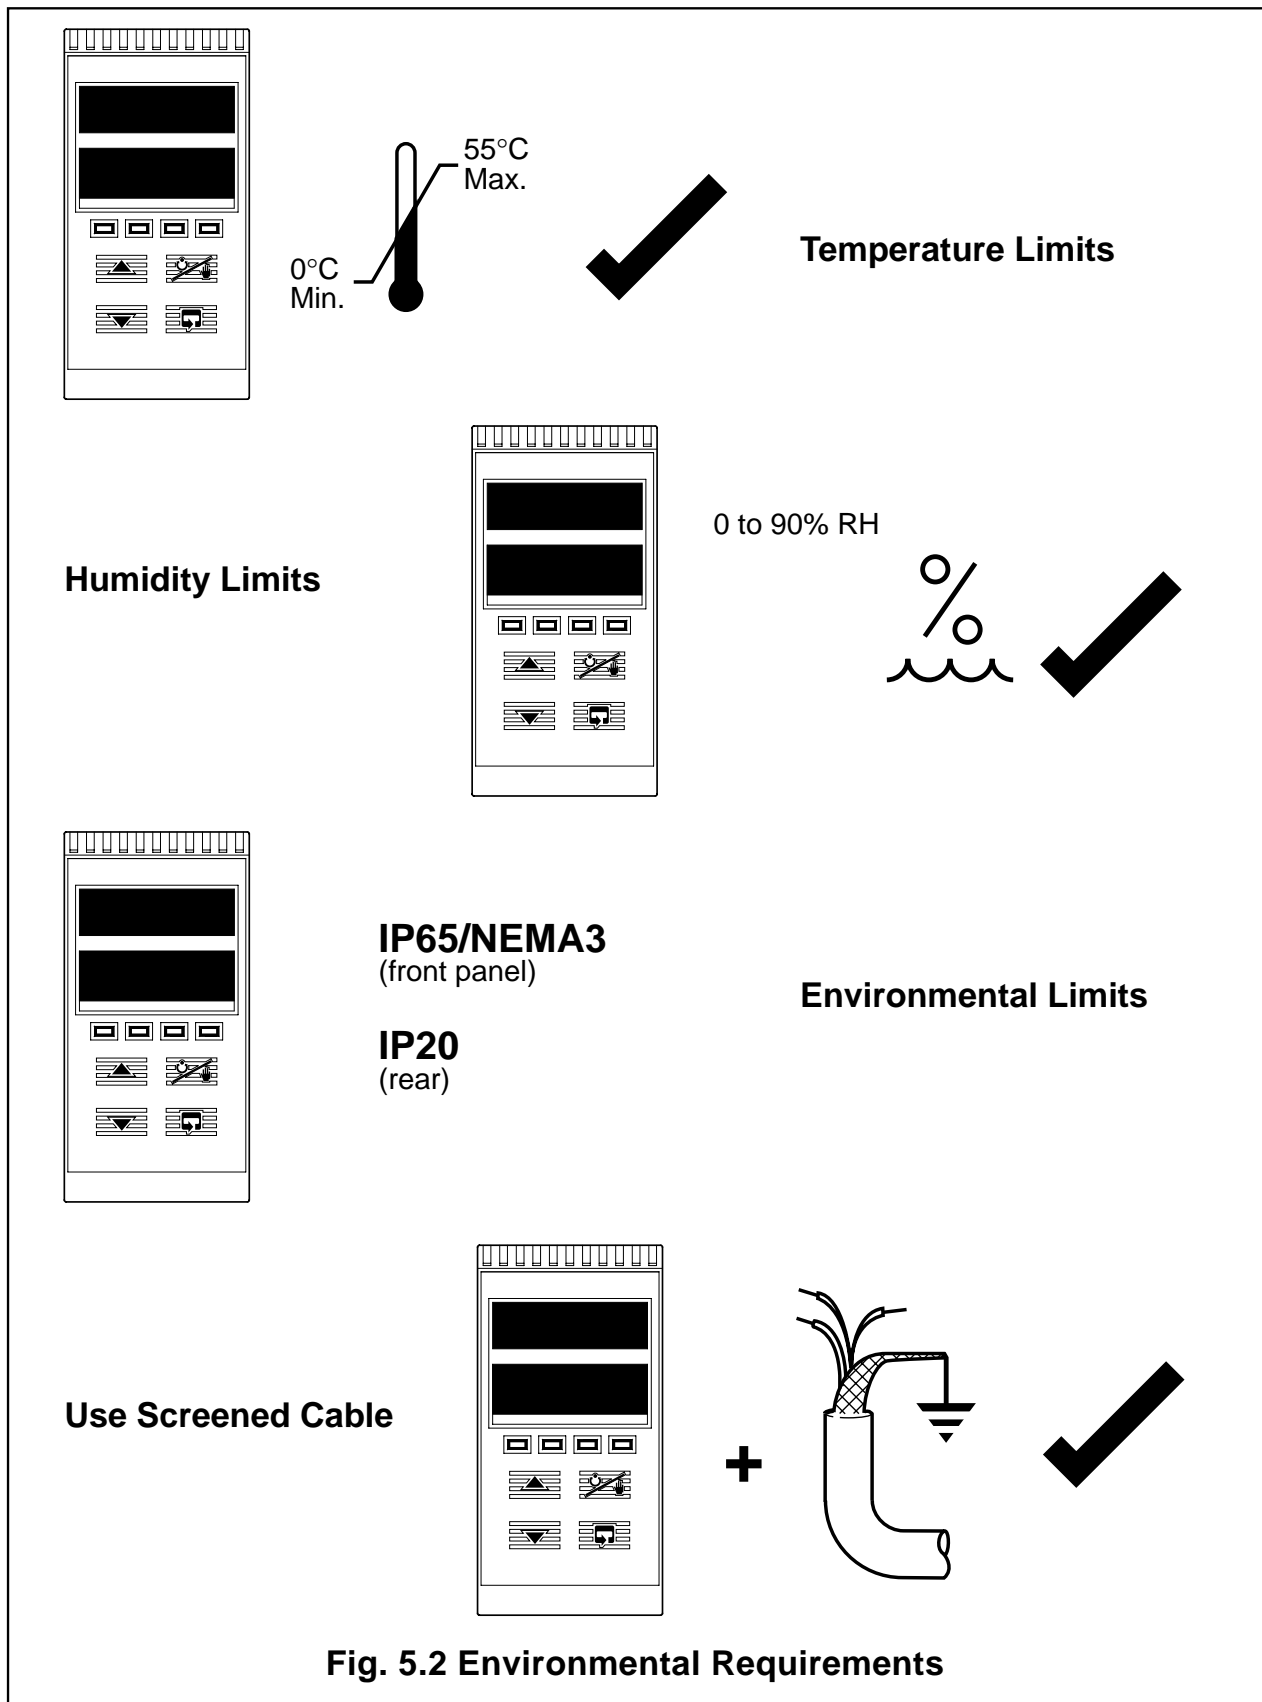



5.2 Mounting – Figs. 5.3 and 5.4

The instrument is designed for panel mounting (see Fig. 5.4). Overall dimensions are shown in Fig. 5.3.

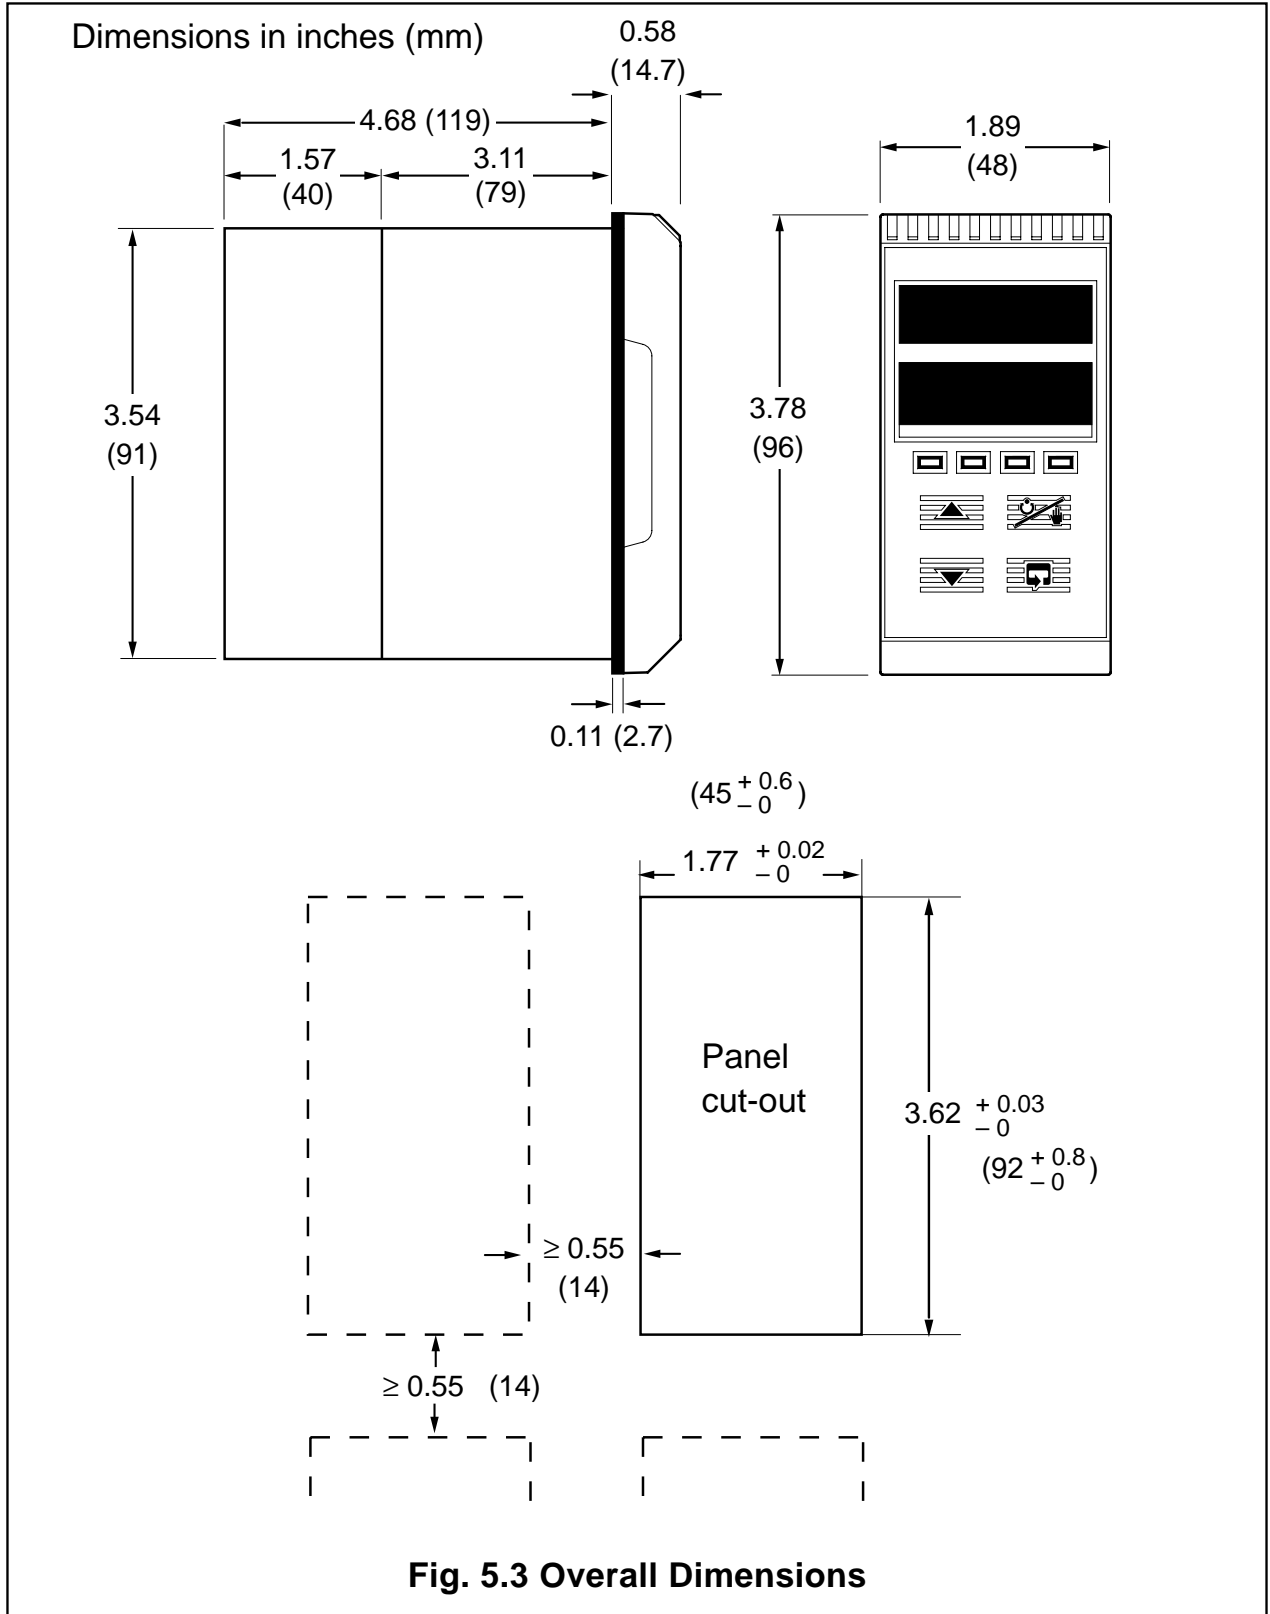



...5 INSTALLATION

...5.2 Mounting – Figs. 5.3 and 5.4

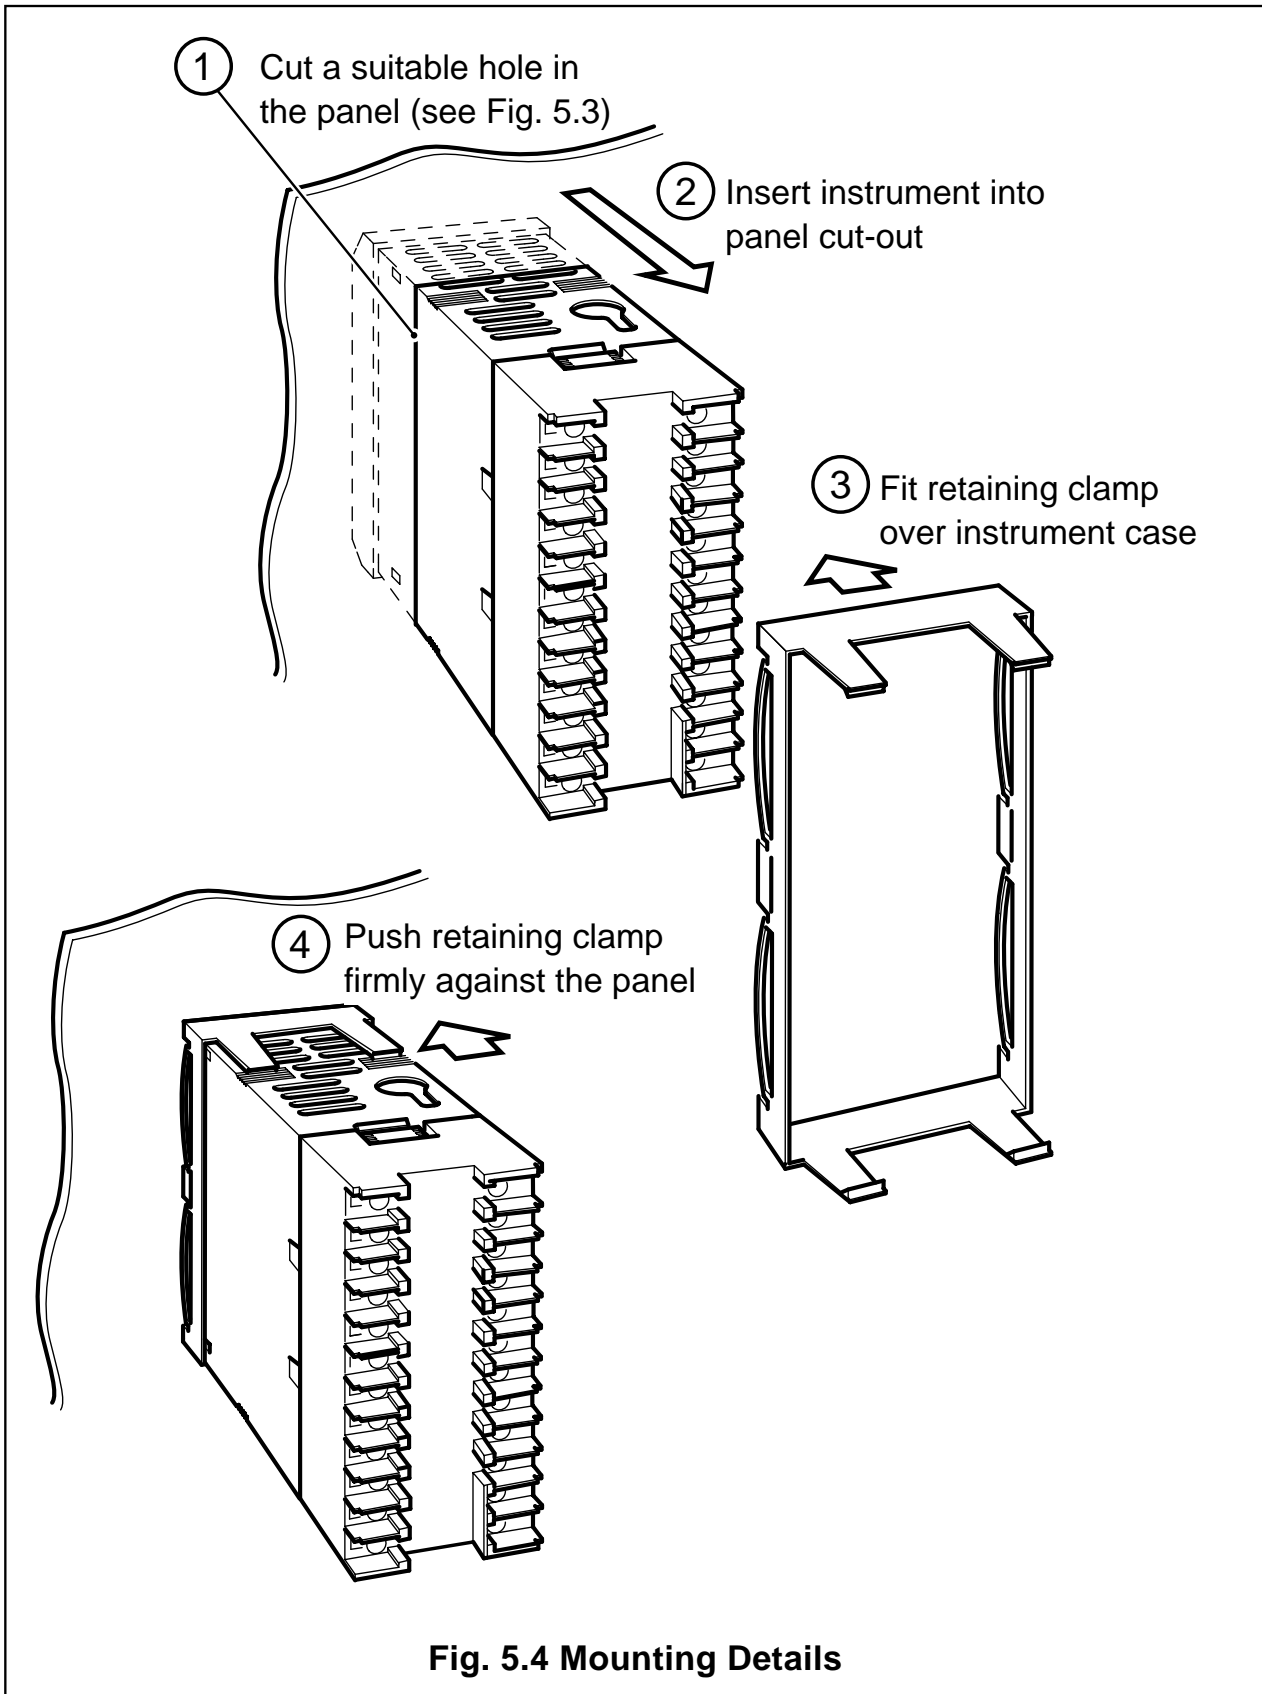


Fig. 5.4 Mounting Details



EC Directive 89/336/EEC

In order to meet the requirements of the EC Directive 89/336/EEC for EMC regulations, this product must not be used in a non-industrial environment.

5.3 Electrical Connections – Fig. 5.5 (overleaf)

Warning. Before making any connections, ensure that the power supply, any powered control circuits and high common mode voltages are switched off.

Note. If it is not possible to avoid strong electrical and magnetic fields, screened cables within earthed metal conduit must be used.

5.4 Relays, Arc Suppression, Inputs and Outputs

5.4.1 Relay Contact Ratings

Relay contacts are rated at:

115/230V AC at 5A (non-inductive).

250V DC 25W max.

5.4.2 Arc Suppression

Arc suppression components are fitted to relay outputs 2 and 3 only. The arc suppression components supplied must be fitted to relay output 1.

5.4.3 Logic Output

18V DC at 20mA, minimum load 900Ω.

Isolated from inputs (not from analog O/P),

dielectric strength 500V d.c. for 1 minute.

5.4.4 Retransmission Analog Output

Max. load 15V (750Ω at 20mA).

Isolated from inputs (not from logic O/P),

dielectric strength 500V d.c. for 1 minute.


5.4.5 Digital Input

Type: Volt-free


Minimum Pulse: 250ms



...5 INSTALLATION

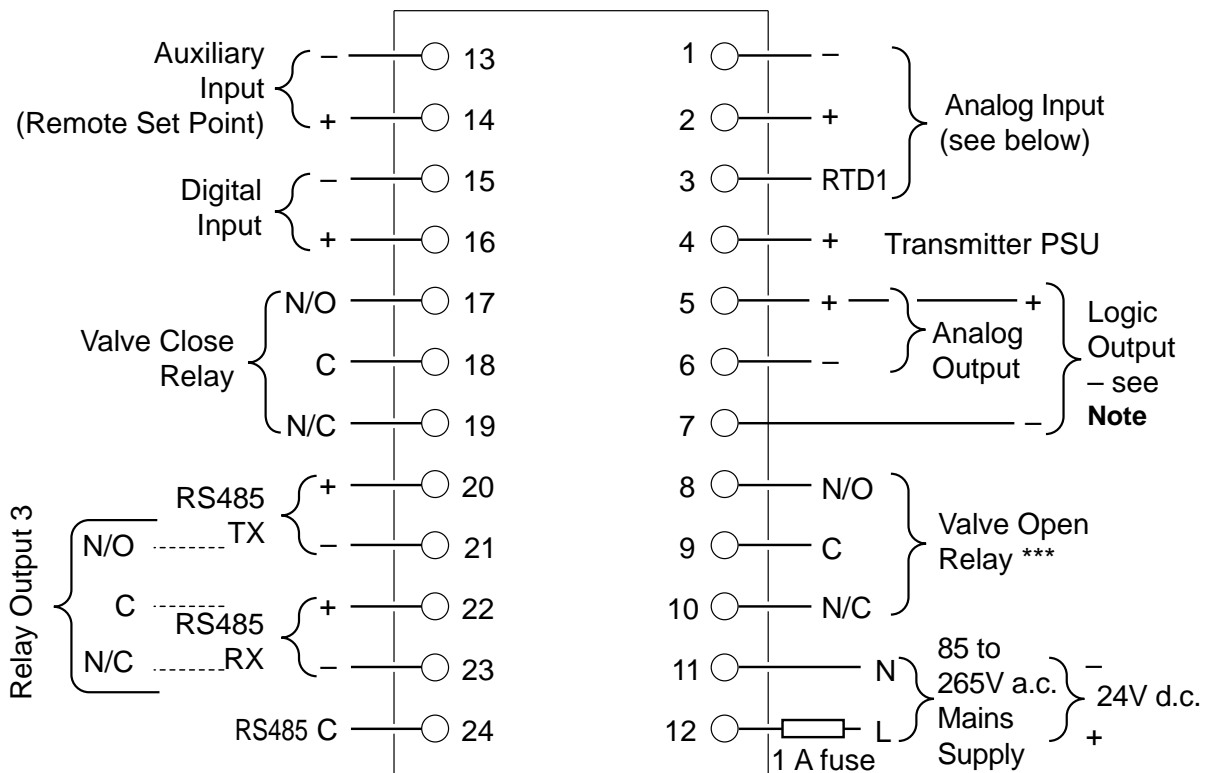

Note. The analog output and logic output use a common positive terminal, capable of driving both outputs simultaneously.

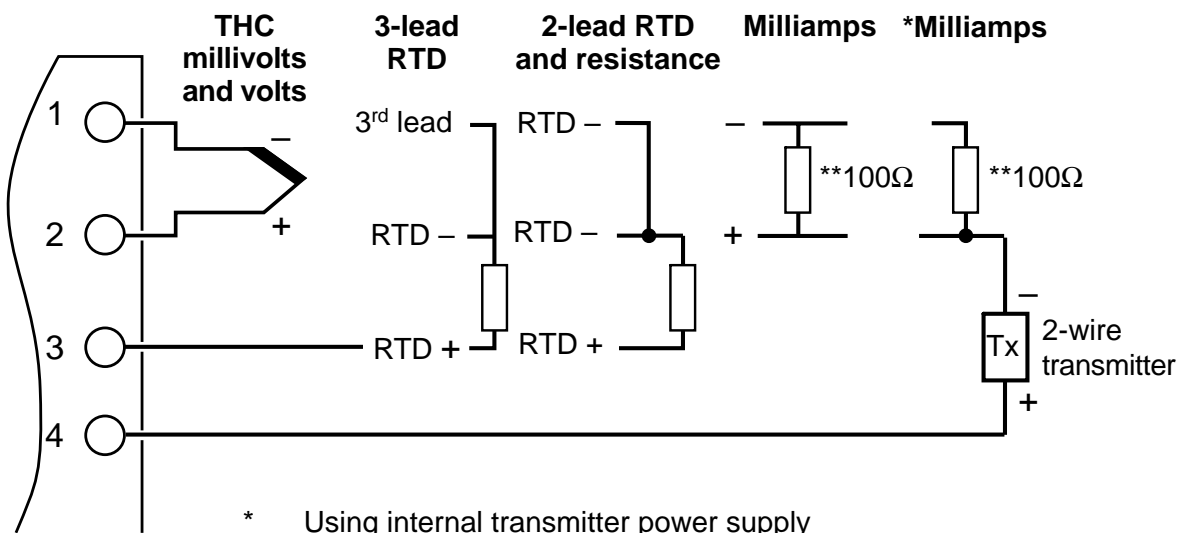

- * Using internal transmitter power supply
- ** Use 100Ω shunt resistor provided with instrument
- *** Fit the arc suppression component provided with instrument

Fig. 5.5 Electrical Connections

Customer Support

We provide a comprehensive after sales service via our Worldwide Service Organization. Contact one of the following offices for details of your nearest Service and Repair Centre.

United Kingdom

ABB Limited
Tel: +44 (0)1480 475321
Fax: +44 (0)1480 217948

United States of America

ABB Inc.
Tel: +1 215 674 6000
Fax: +1 215 674 7183


Client Warranty

Prior to installation, the equipment referred to in this manual must be stored in a clean, dry environment, in accordance with the Company's published specification. Periodic checks must be made on the equipment's condition.

In the event of a failure under warranty, the following documentation must be provided as substantiation:

1. A listing evidencing process operation and alarm logs at time of failure.
2. Copies of all storage, installation, operating and maintenance records relating to the alleged faulty unit.

CUSTOMER SETUP LOG

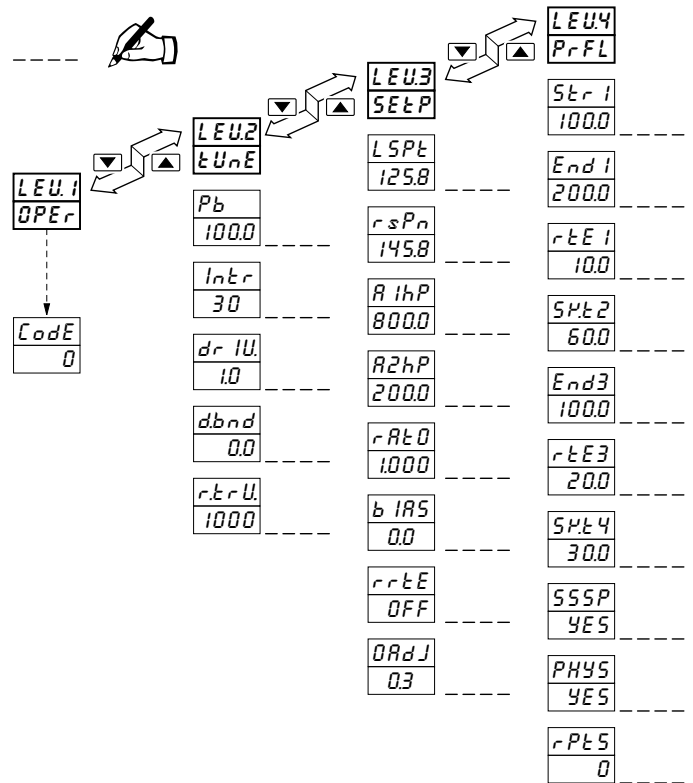

Company Standard settings are shown in the lower display

Instrument Serial Number: _____

Product Code: V 1 0 0 / _ _ _ _ / _ _ _ _





CUSTOMER CONFIGURATION LOG

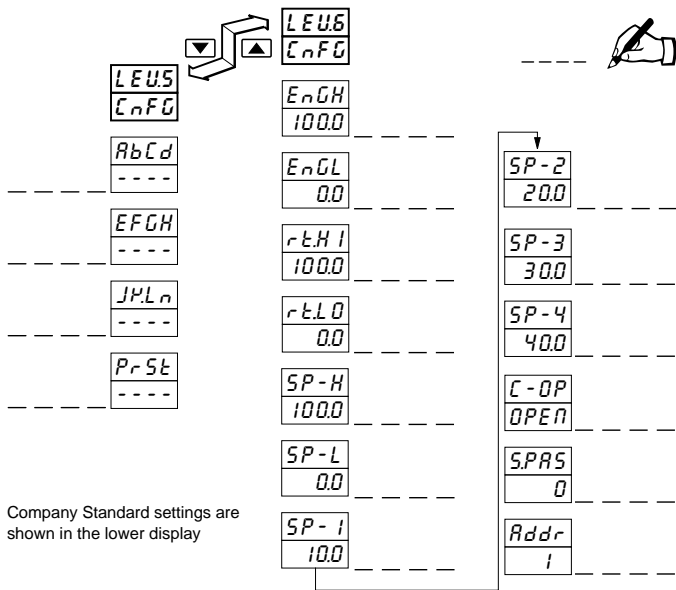


ABB has Sales & Customer Support expertise in over 100 countries worldwide

The Company's policy is one of continuous product improvement and the right is reserved to modify the information contained herein without notice.

Printed in UK (03.05)

© ABB 2005

IMV100 Issue 6



Distributed by



PO Box 1 • Ilkley • West Yorkshire • LS29 8EU
 Phone: 01943 602001 • Fax: 01943 816796
 Website: www.issltd.co.uk • Email: sales@issltd.co.uk

Instrumentation
Systems & Services Ltd



Tel: (01943) 602001- WWW.ISSLTD.CO.UK - Fax: (01943) 816796

